


- NOTES:
1. GAS/DIESEL USE
 2. ENVIROLASTIC 940 DTM POLYASPARTIC URETHANE COATING FOR HIGH PERFORMANCE FINISH (MEMCO GREY)
 3. UL 2085 LABELED AND LISTED
 4. 2 HOUR RATING TESTED TO SWRI 97-04 NFPA 30 A FIRE RESISTANT TANK
 5. ENGINEERED HURRICANE TIE-DOWN
 6. LEAD TIME IS DEPENDENT ON IMMEDIATE APPROVAL

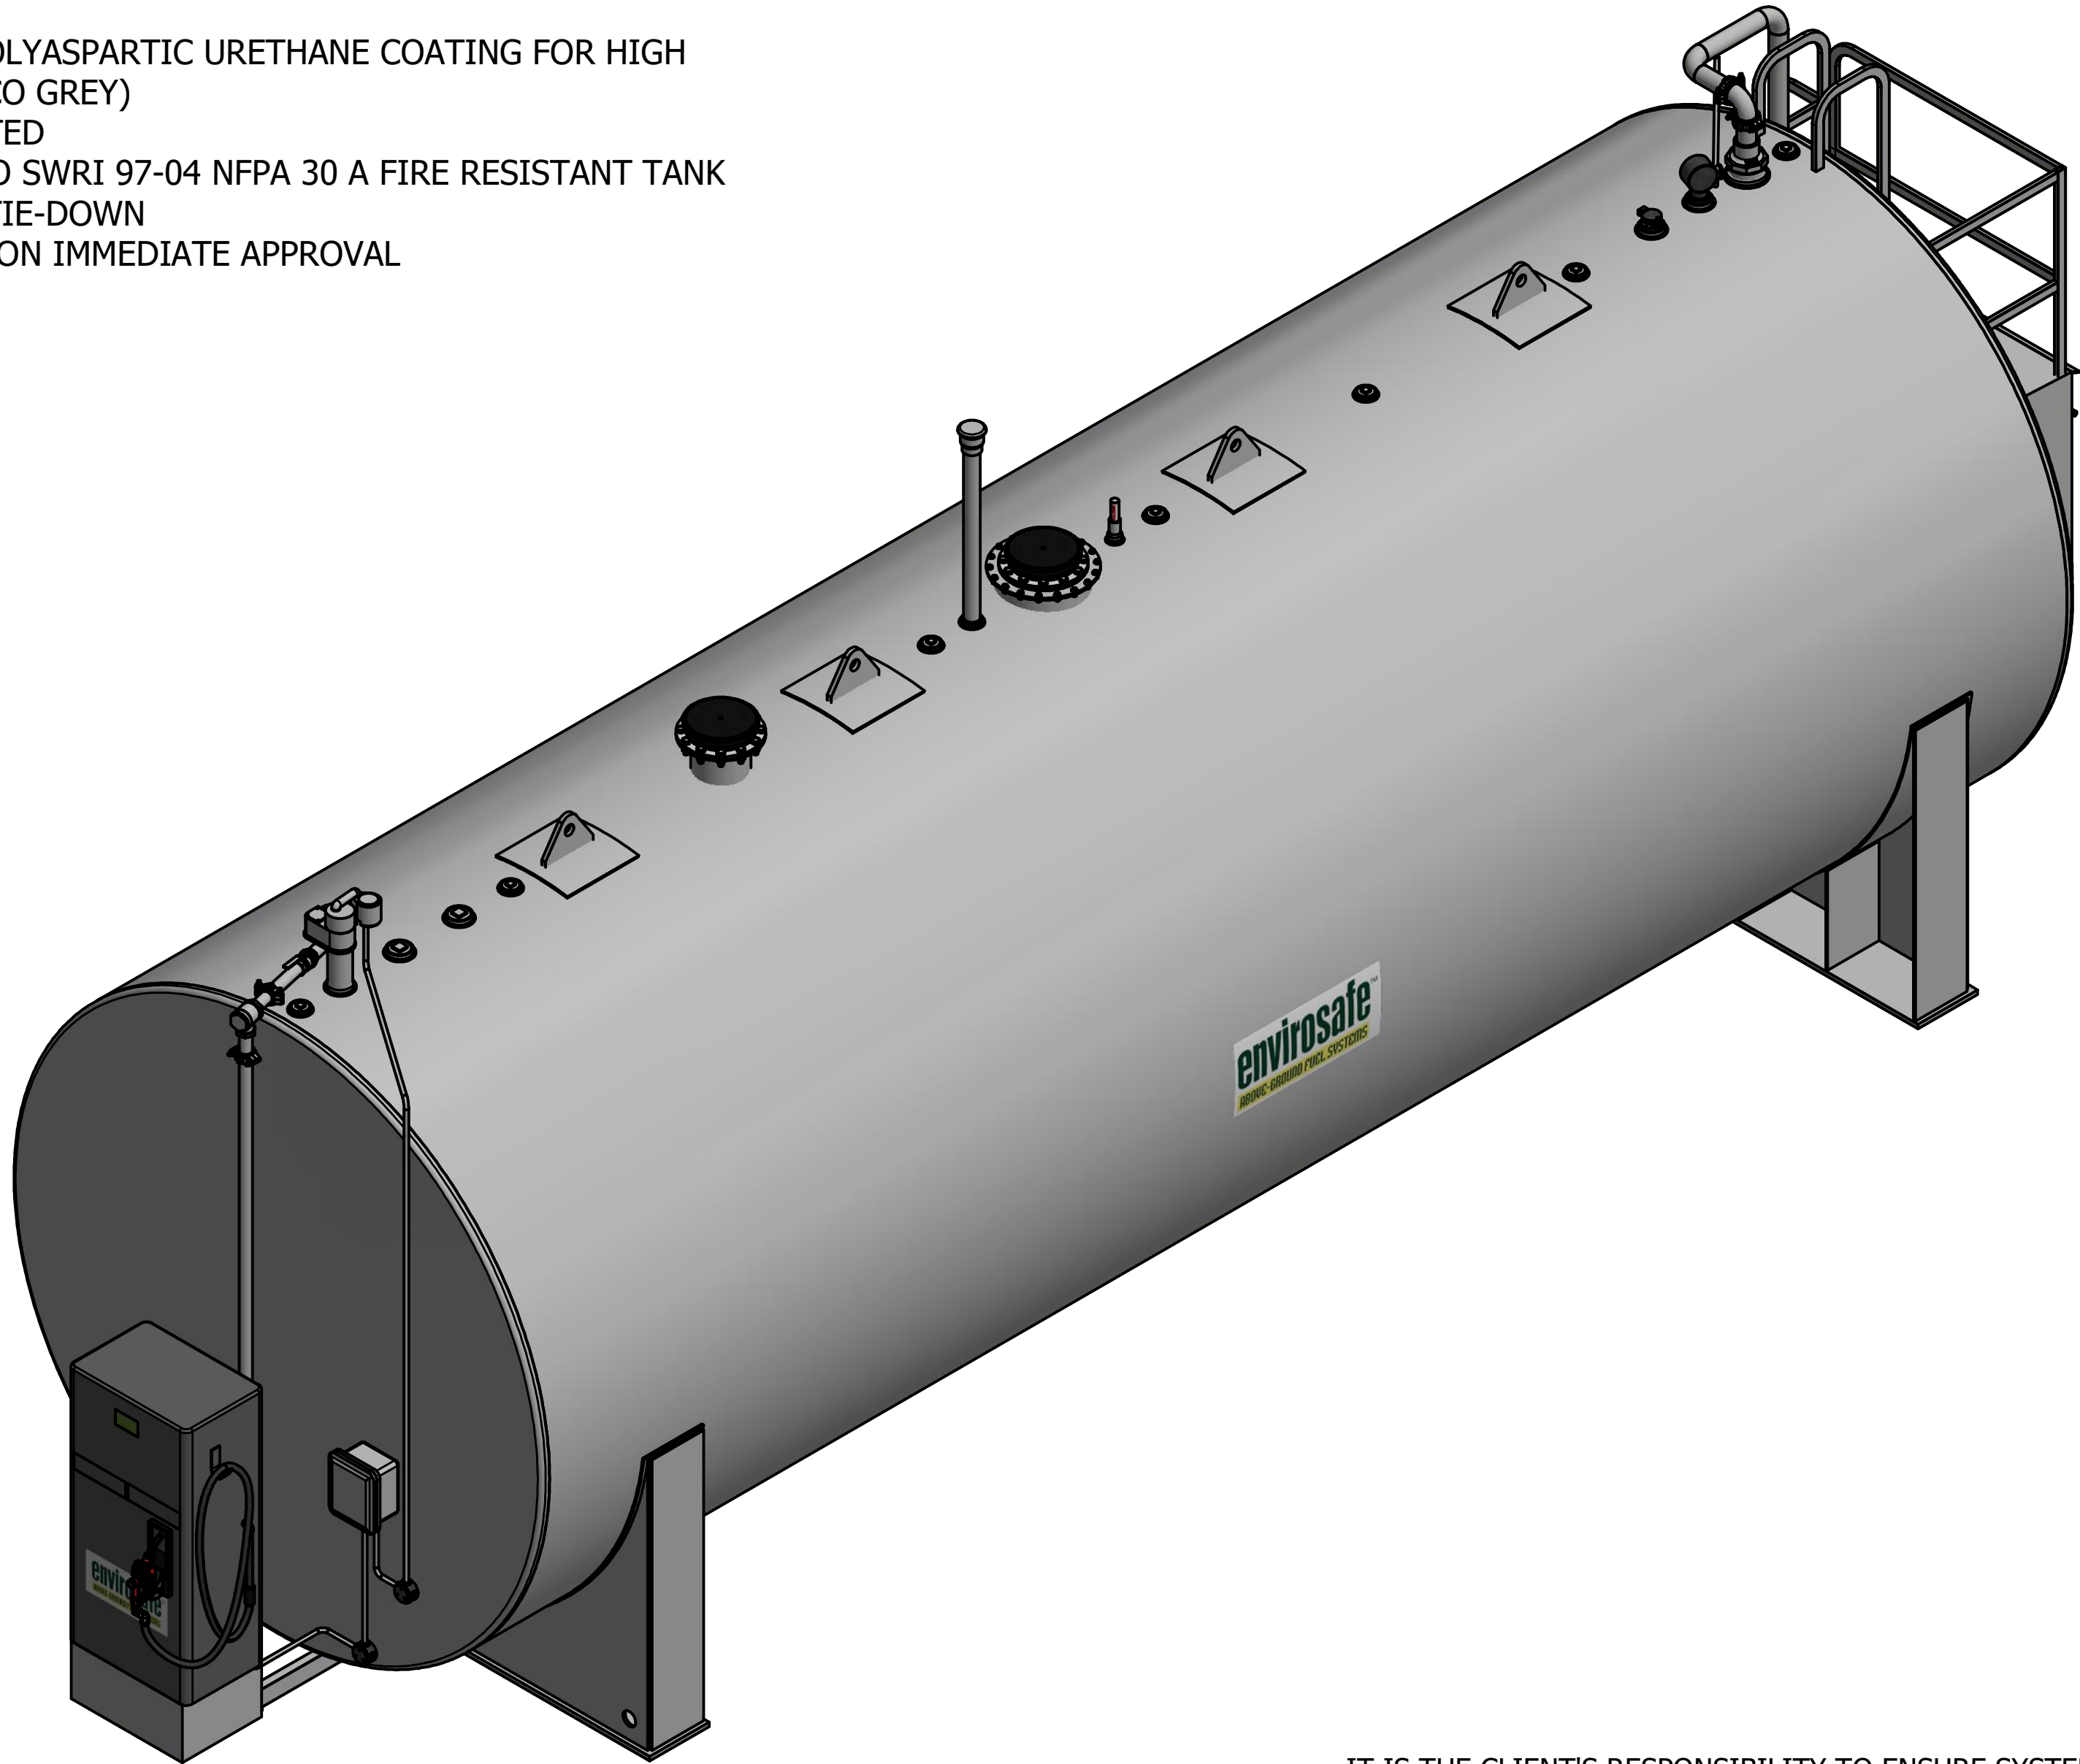

*LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED
DRAWING, WHICH MUST BE RETURNED BEFORE
PRODUCTION CAN BEGIN*

#



STI
SwRI
UL

This document and all information and design thereon are the property of Envirosafe Fuel Systems. This document is confidential and must not be made public or copied without written authorization from Envirosafe and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by Envirosafe. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

IT IS THE CLIENT'S RESPONSIBILITY TO ENSURE SYSTEM COMPLIANCE WITH
APPLICABLE REGULATIONS.

DRAWN BY AP MEMCO REP	4/15/2020	MEMCO, INC	
QUOTE #20000 GALLON FG DISPENSER		<div>envirosafe™</div> <div>20,000 GALLON FIREGUARD DISPENSER SYSTEM</div> <div>ABOVE-GROUND FUEL SYSTEMS</div>	
Customer Approval Signature			
CUSTOMER REQUESTED COMPLETION DATE :		SIZE C	REV
		SCALE	
		SHEET 1 OF 5	

PARTS LIST			PARTS LIST		
ITEM	QTY	DESCRIPTION	ITEM	QTY	DESCRIPTION
1	1	20,000 GALLON FIREGUARD TANK MOUNTED ON SADDLE	14	1	3" OVERFILL PREVENTION VALVE WITH TEST MECHANISM AND DIFFUSER
2	1	18" MANWAY W/7" NECK FOR EASY INNER TANK ACCESSIBILITY	15	1	3" GROUND LEVEL FILL WITH DUST CAP AND ADAPTOR
3	1	6 IN NPT THREADED FLANGE	16	1	STEP LADDER TO ACCESS TOP OF TANK WITH HANDRAIL SYTEM AND SAFETY SHIELD
4	5	4 IN NPT THREADED FLANGE	17	1	918 CLOCK GAUGE WITH ALARM BOX & STANDARD FLOAT
5	7	3" NPT THREADED FLANGE (CONCRETE PORT)	18	1	MONITORING CAP 2"
6	1	3 IN NPT THREADED FLANGE	19	1	FE PETRO 3/4 HP w/RISER, 88IN - 149IN (240V 1 PH)
7	2	2 IN NPT THREADED FLANGE	20	1	2" ANTI-SIPHON VALVE
8	2	10" 8 OZ. FLANGE E-VENT KIT	21	1	VALVE BALL 2IN
9	4	LIFTING LUG	22	1	ENCLOSURE ADALET HAZ LOC TYPE 4/7/9 8"x10"x6" W/ PAN & HINGES W/ 3-1/2" NPT CONDUIT
10	1	3" UPDRAFT STACK W/3" 354 SLIP ON	23	1	INTERSTITIAL LEAK GAUGE
11	1	DISPENSER BENNETT SINGLE PRODUCT 3711SNR-18-J-P-SO DISPENSER w/10:1 PULSER (ENVIROSAFE LOGO ON DOOR)	24	1	ROM DOOR 3'x3'
12	1	VALVE EMERGENCY SHUT-OFF 2"x1.5" CONTAINMENT BODY STYLE	25	1	TANK DECAL KIT (NOT SHOWN)
13	1	UL LISTED LOCKABLE 3'6"x4'2"x4' FILL BOX, CROSS BROKEN FOR EASY DRAINAGE, 2" STACK VENT AND 1/2" BALL VALVE	26	1	TOUCH UP PAINT (NOT SHOWN AND SHIPPED SEPARAELY)

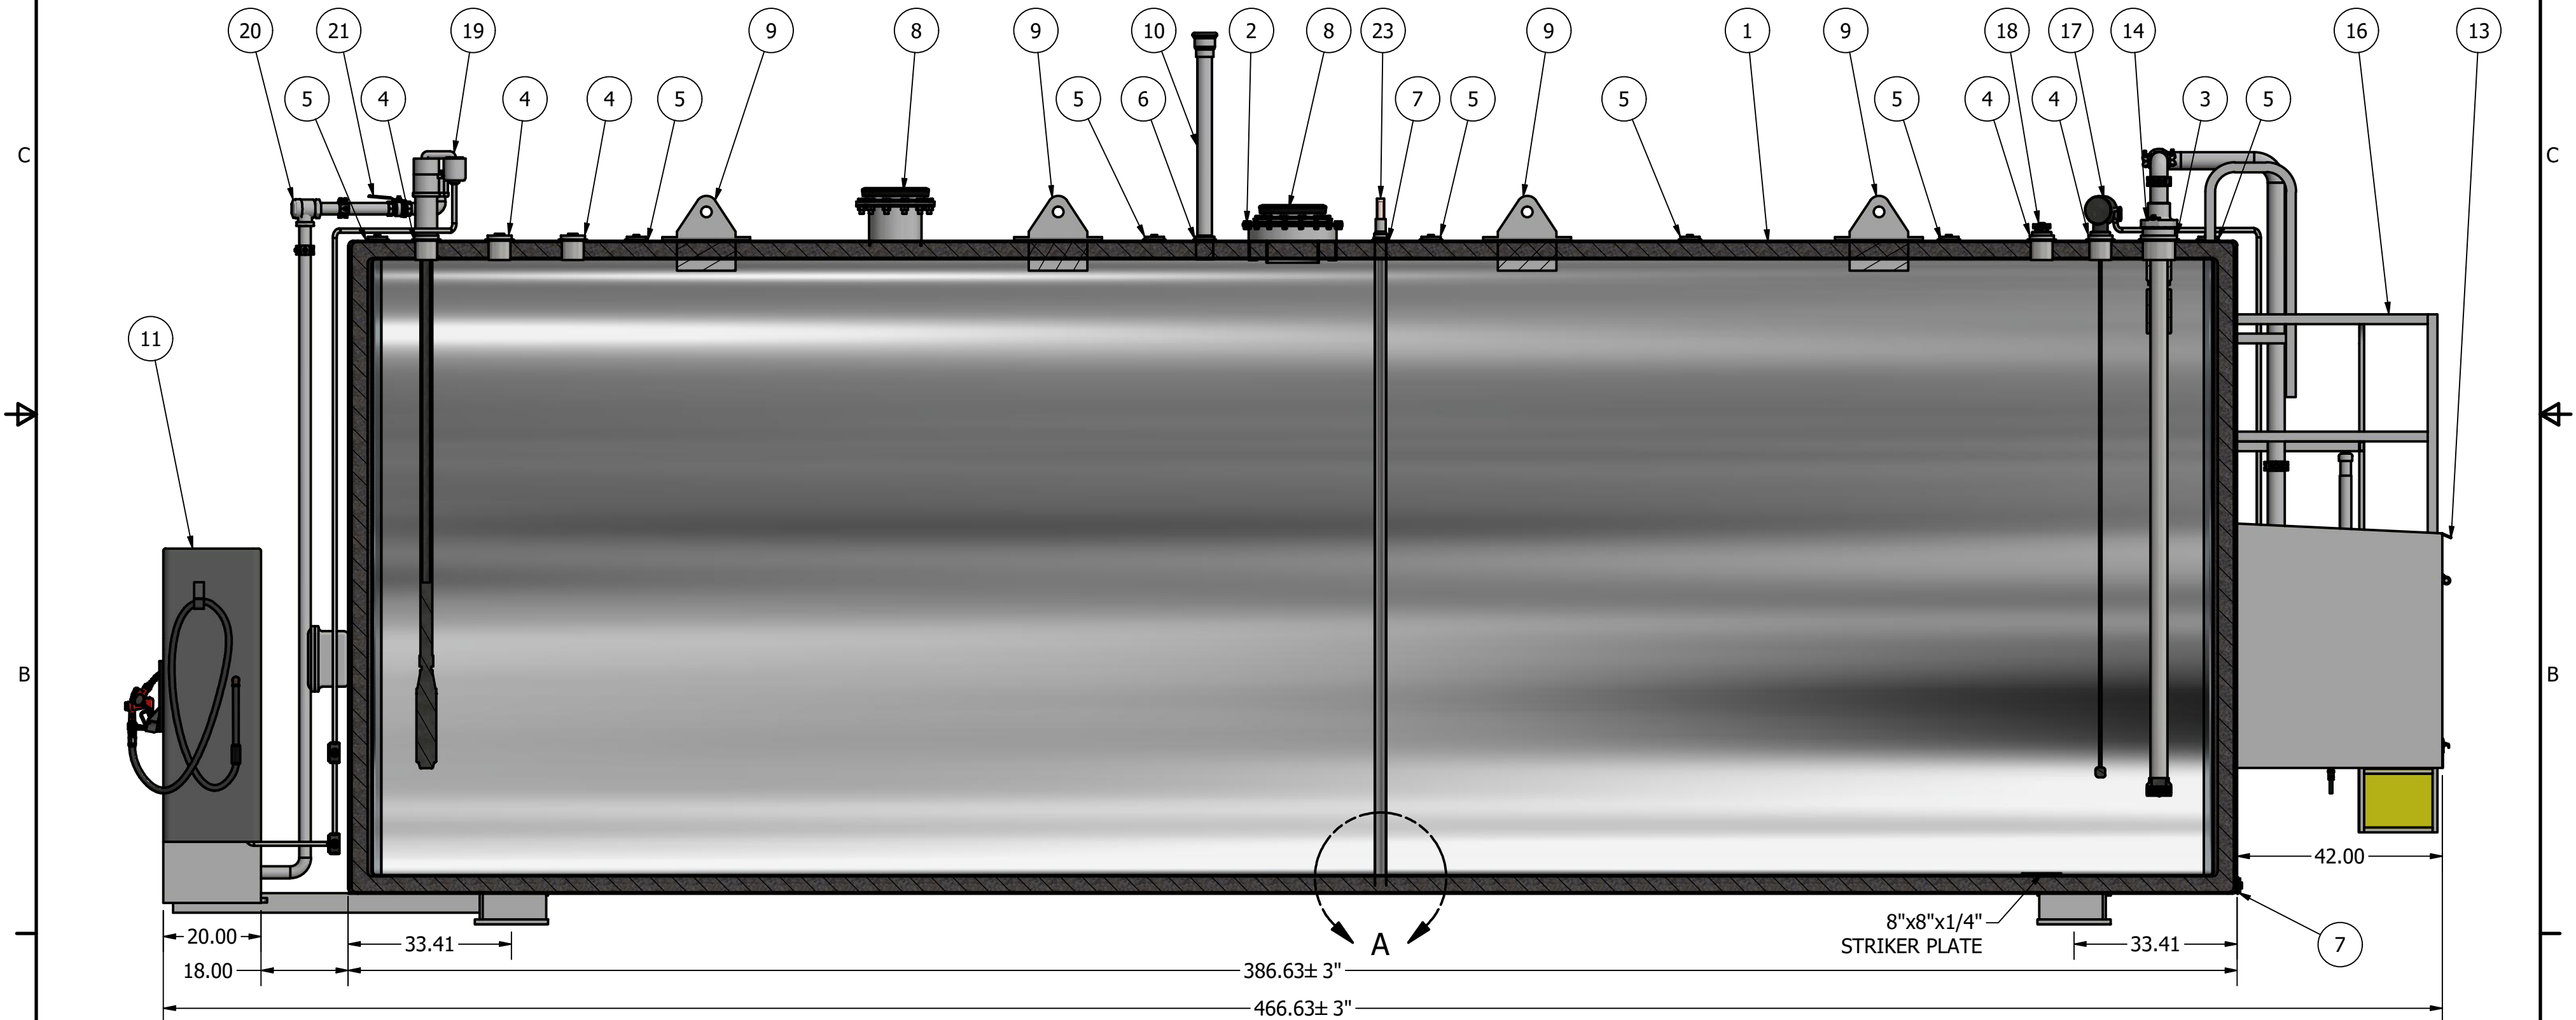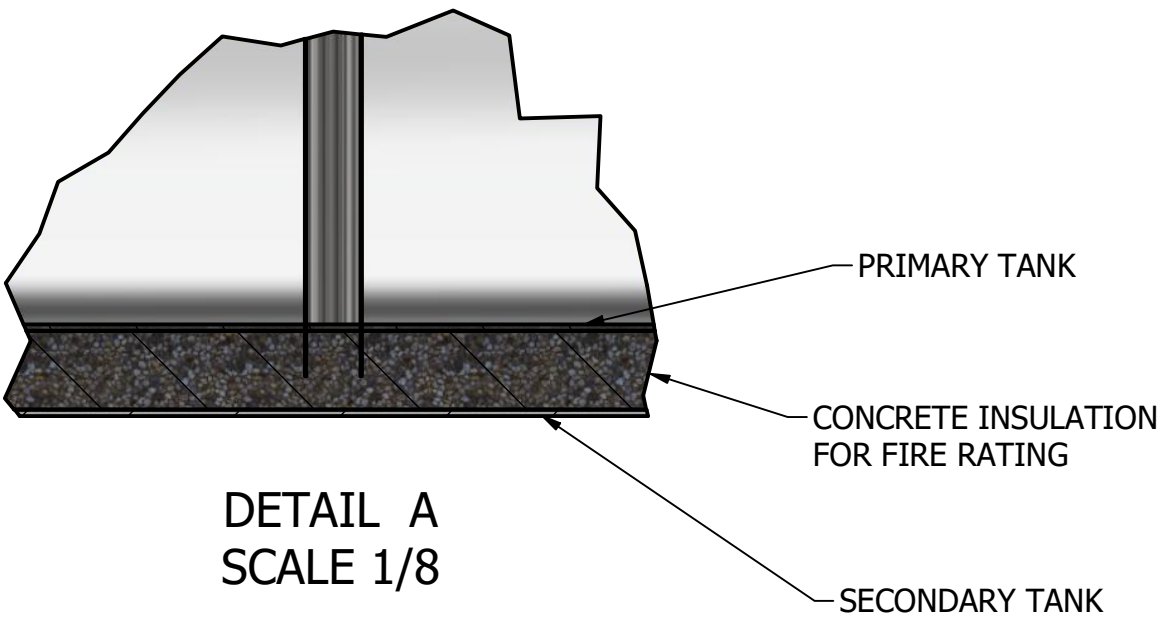

IT IS THE CLIENT'S RESPONSIBILITY TO ENSURE SYSTEM COMPLIANCE WITH APPLICABLE REGULATIONS.

LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED DRAWING, WHICH MUST BE RETURNED BEFORE PRODUCTION CAN BEGIN


#

SHELL THICKNESS: 1/4"
HEAD THICKNESS: 1/4"

STI
SwRI
UL

This document and all information and design thereon are the property of Envirosafe Fuel Systems. This document is confidential and must not be made public or copied without written authorization from Envirosafe and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by Envirosafe. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

DRAWN BY AP MEMCO REP	4/15/2020	MEMCO, INC			
QUOTE # 20000 GALLON FG DISPENSER		20,000 GALLON FIREGUARD DISPENSER SYSTEM			
Customer Approval Signature		20,000 GALLON FIREGUARD DISPENSER SYSTEM			
		SIZE C	DWG NO 20000 GALLON FG DISPENSER		REV
		SCALE		SHEET 2 OF 5	

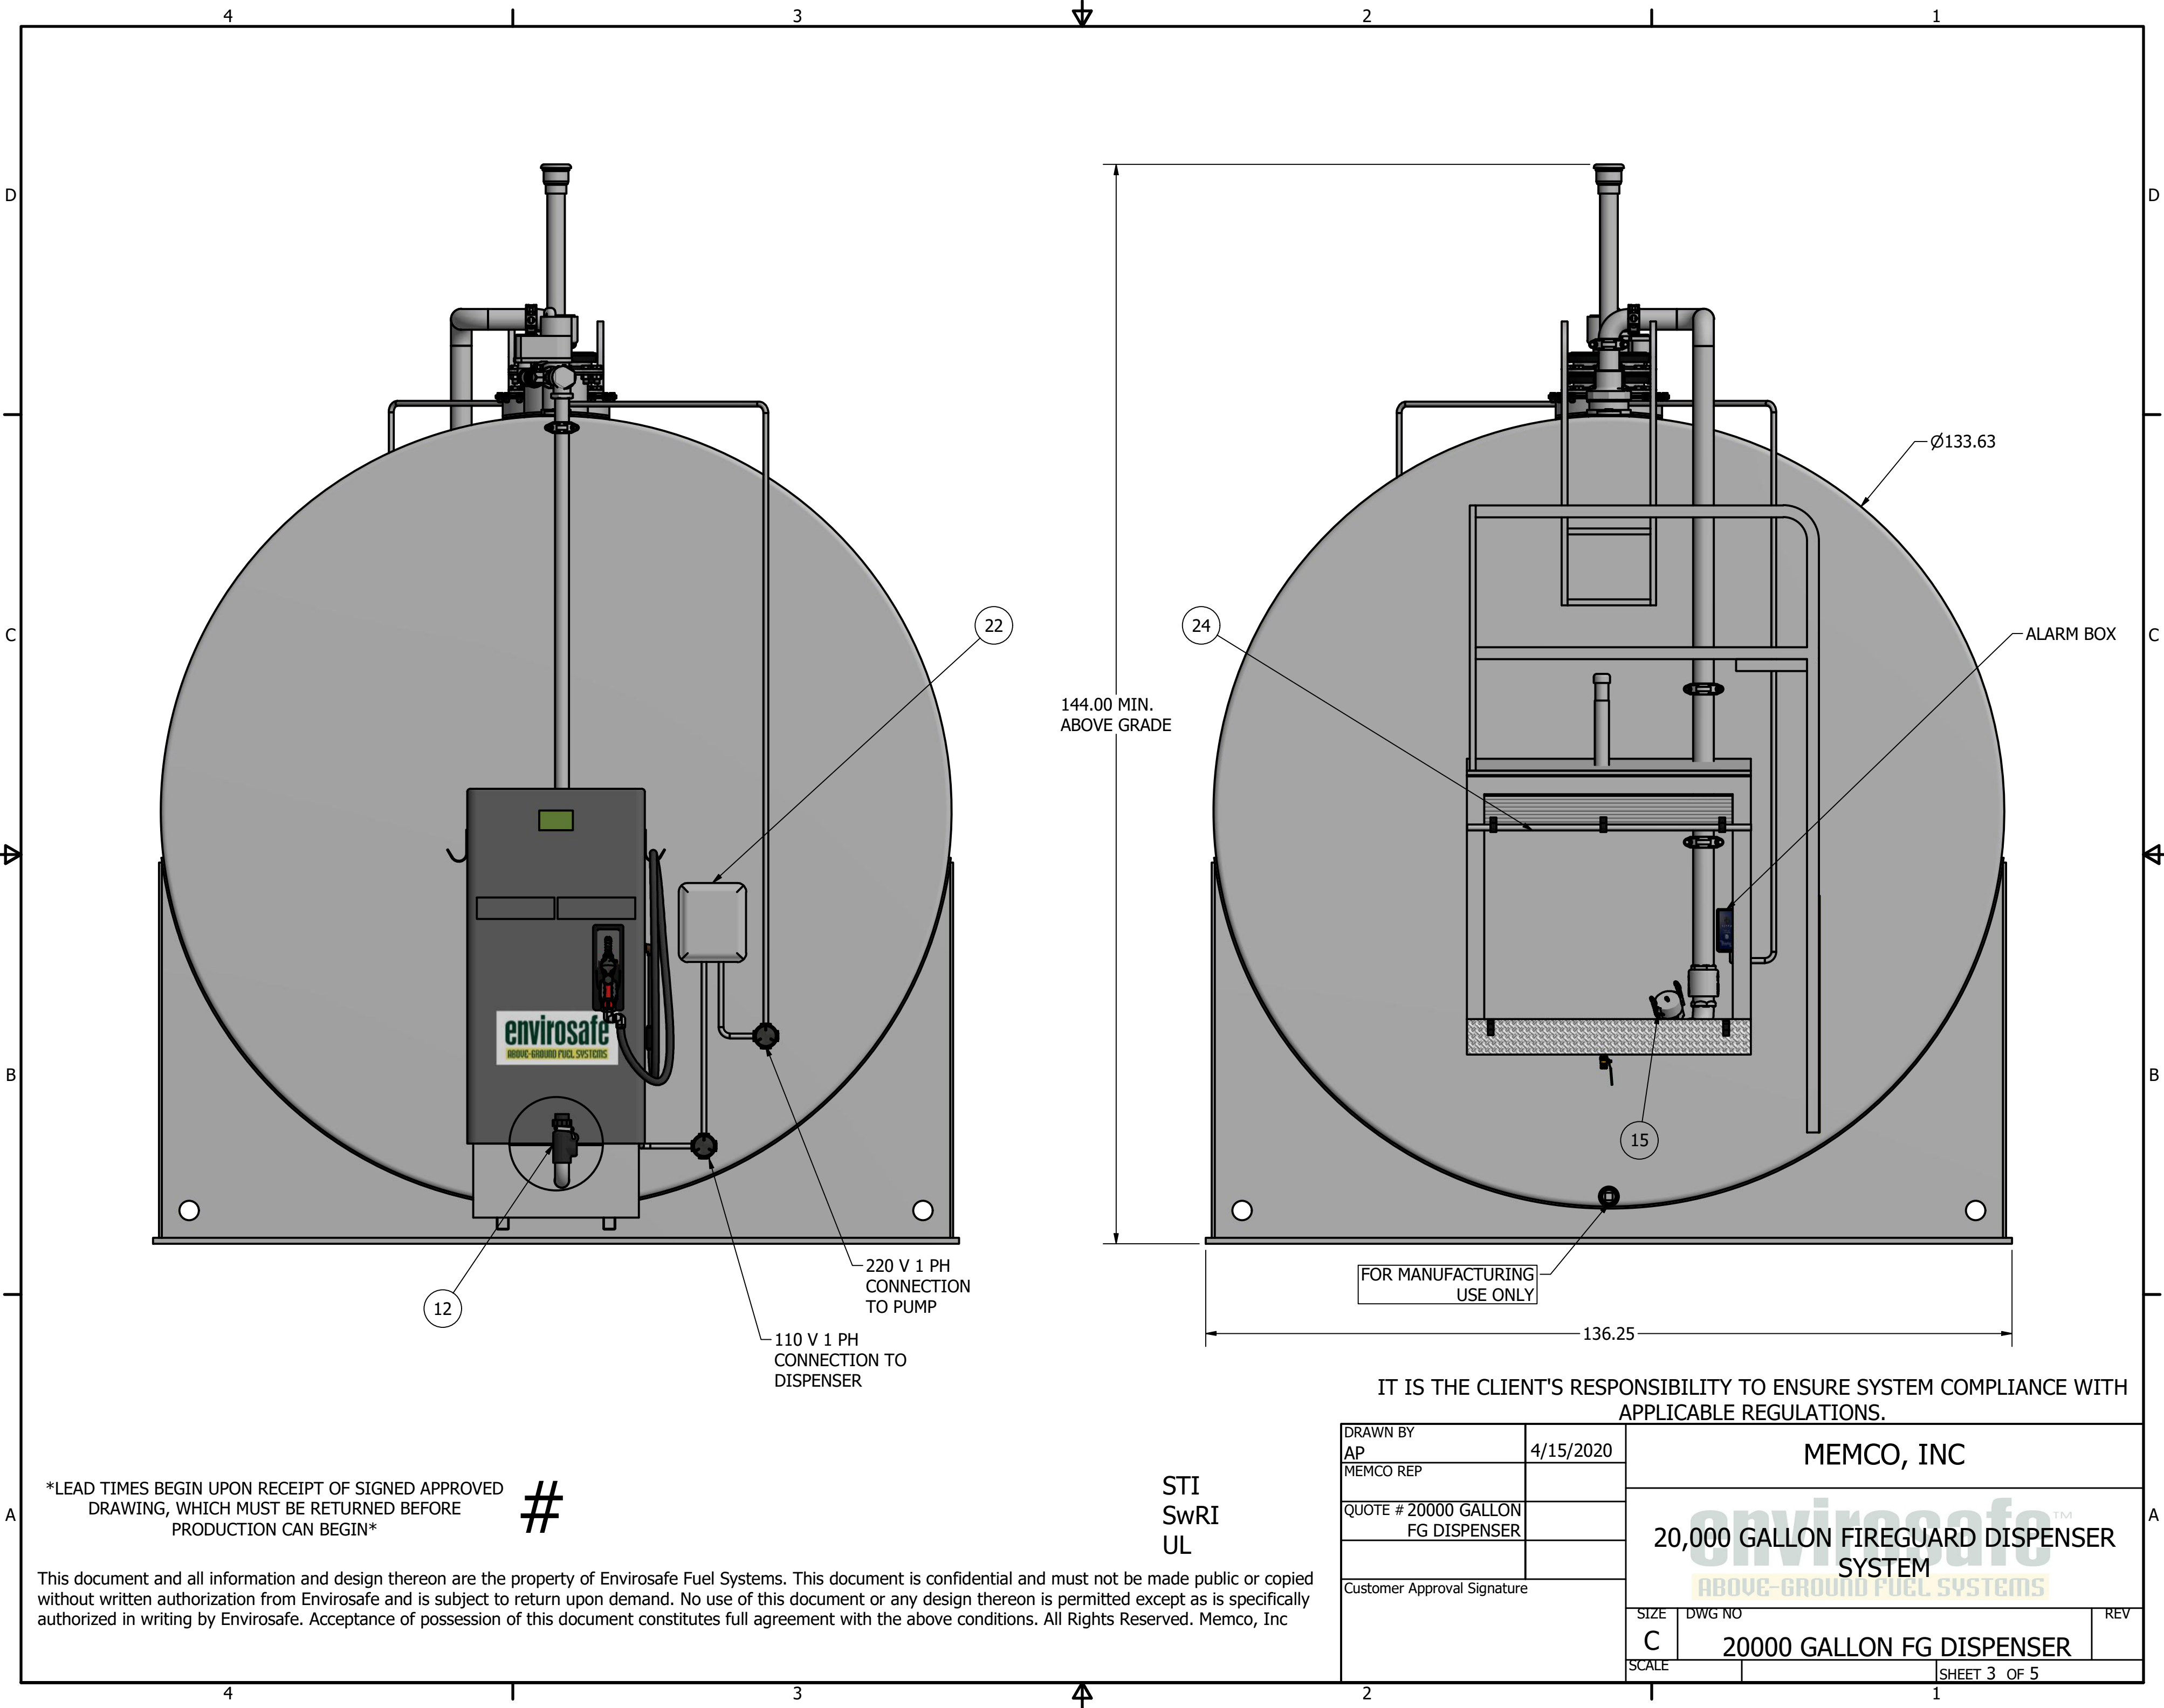


LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED DRAWING, WHICH MUST BE RETURNED BEFORE PRODUCTION CAN BEGIN


#

This document and all information and design thereon are the property of Envirosafe Fuel Systems. This document is confidential and must not be made public or copied without written authorization from Envirosafe and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by Envirosafe. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

STI
SwRI
UL

IT IS THE CLIENT'S RESPONSIBILITY TO ENSURE SYSTEM COMPLIANCE WITH APPLICABLE REGULATIONS.

DRAWN BY AP MEMCO REP	4/15/2020	MEMCO, INC	
QUOTE # 20000 GALLON FG DISPENSER		 20,000 GALLON FIREGUARD DISPENSER SYSTEM	
Customer Approval Signature			
SIZE C	DWG NO	20000 GALLON FG DISPENSER	REV
SCALE		SHEET 3 OF 5	

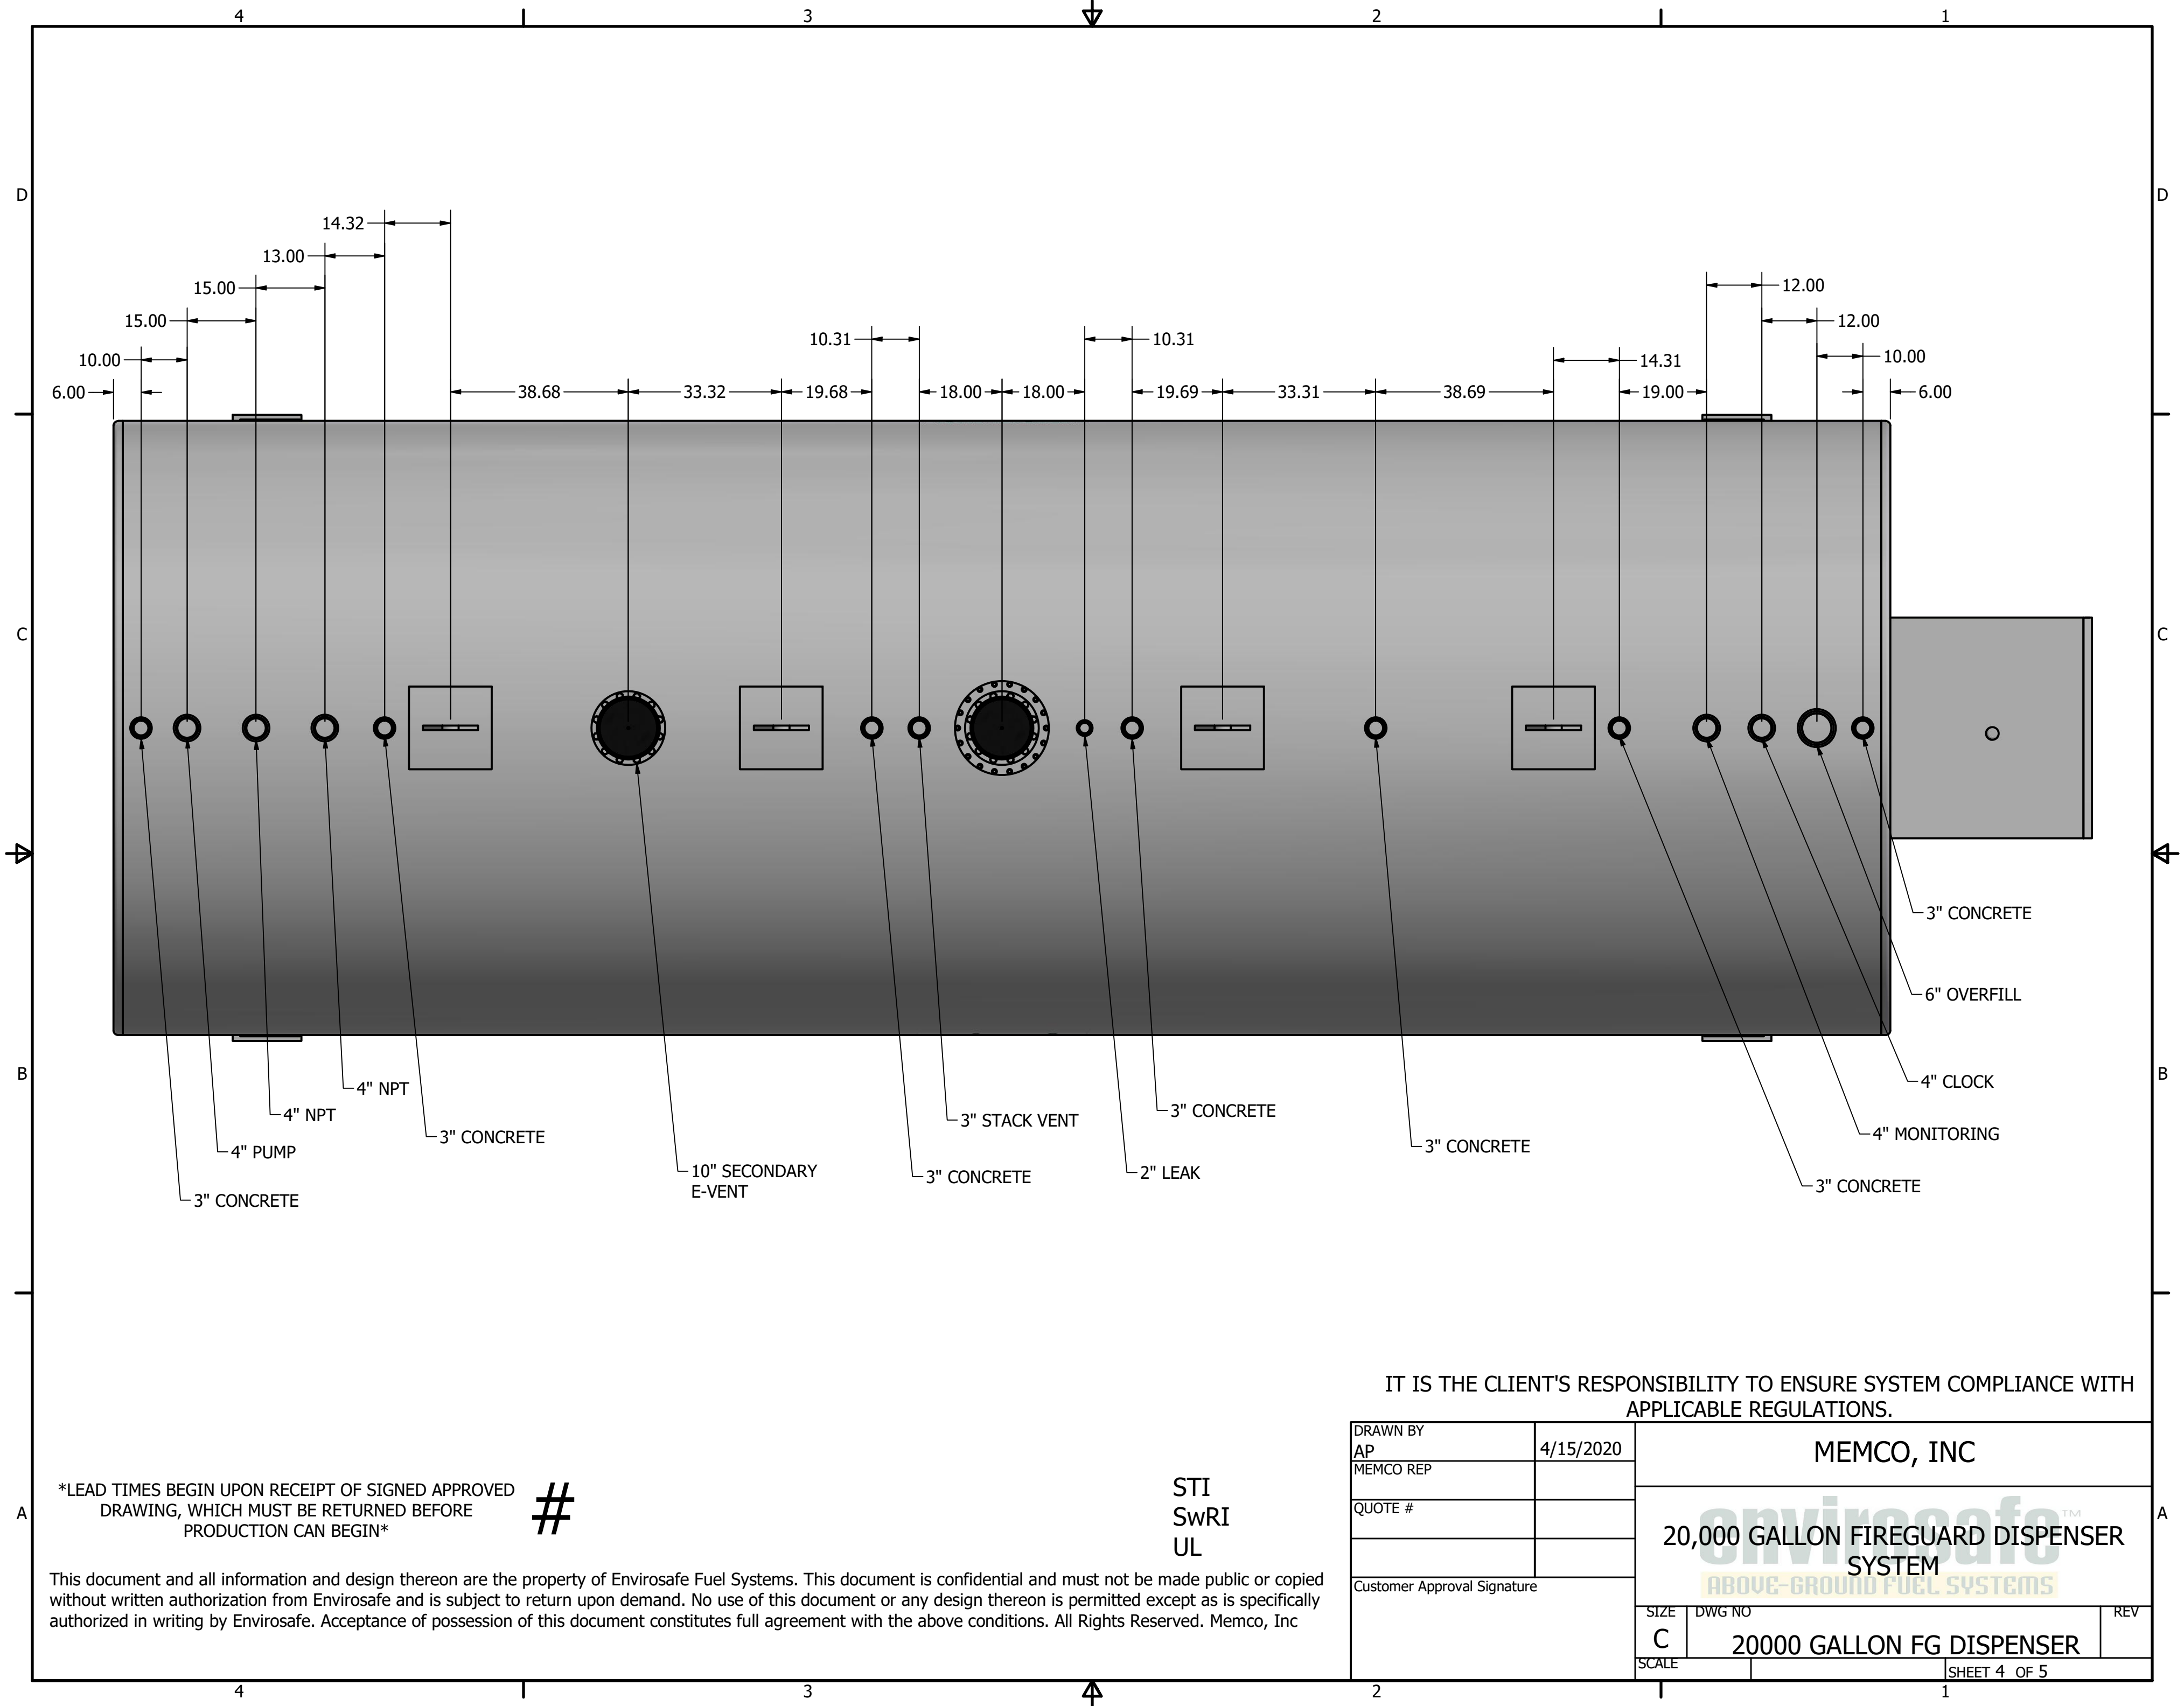

*LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED
DRAWING, WHICH MUST BE RETURNED BEFORE
PRODUCTION CAN BEGIN*

#

This document and all information and design thereon are the property of EnviroSAFE Fuel Systems. This document is confidential and must not be made public or copied without written authorization from EnviroSAFE and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by EnviroSAFE. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

STI
SwRI
UL

IT IS THE CLIENT'S RESPONSIBILITY TO ENSURE SYSTEM COMPLIANCE WITH
APPLICABLE REGULATIONS.

DRAWN BY AP	4/15/2020	MEMCO, INC	
MEMCO REP		<div>envirosafe™</div> <div>20,000 GALLON FIREGUARD DISPENSER SYSTEM</div> <div>ABOVE-GROUND FUEL SYSTEMS</div>	
QUOTE #			
Customer Approval Signature		SIZE C	DWG NO 20000 GALLON FG DISPENSER
		SCALE	REV
		SHEET 4 OF 5	

