


- NOTES:
1. GAS/DIESEL USE
  2. ENVIROLASTIC 940 DTM POLYASPARTIC URETHANE COATING FOR HIGH PERFORMANCE FINISH (MEMCO GREY)
  3. UL 2085 LABELED AND LISTED
  4. 2 HOUR RATING TESTED TO SWRI 97-04 NFPA 30 A FIRE RESISTANT TANK
  5. ENGINEERED HURRICANE TIE-DOWN
  6. LEAD TIME IS DEPENDENT ON IMMEDIATE APPROVAL

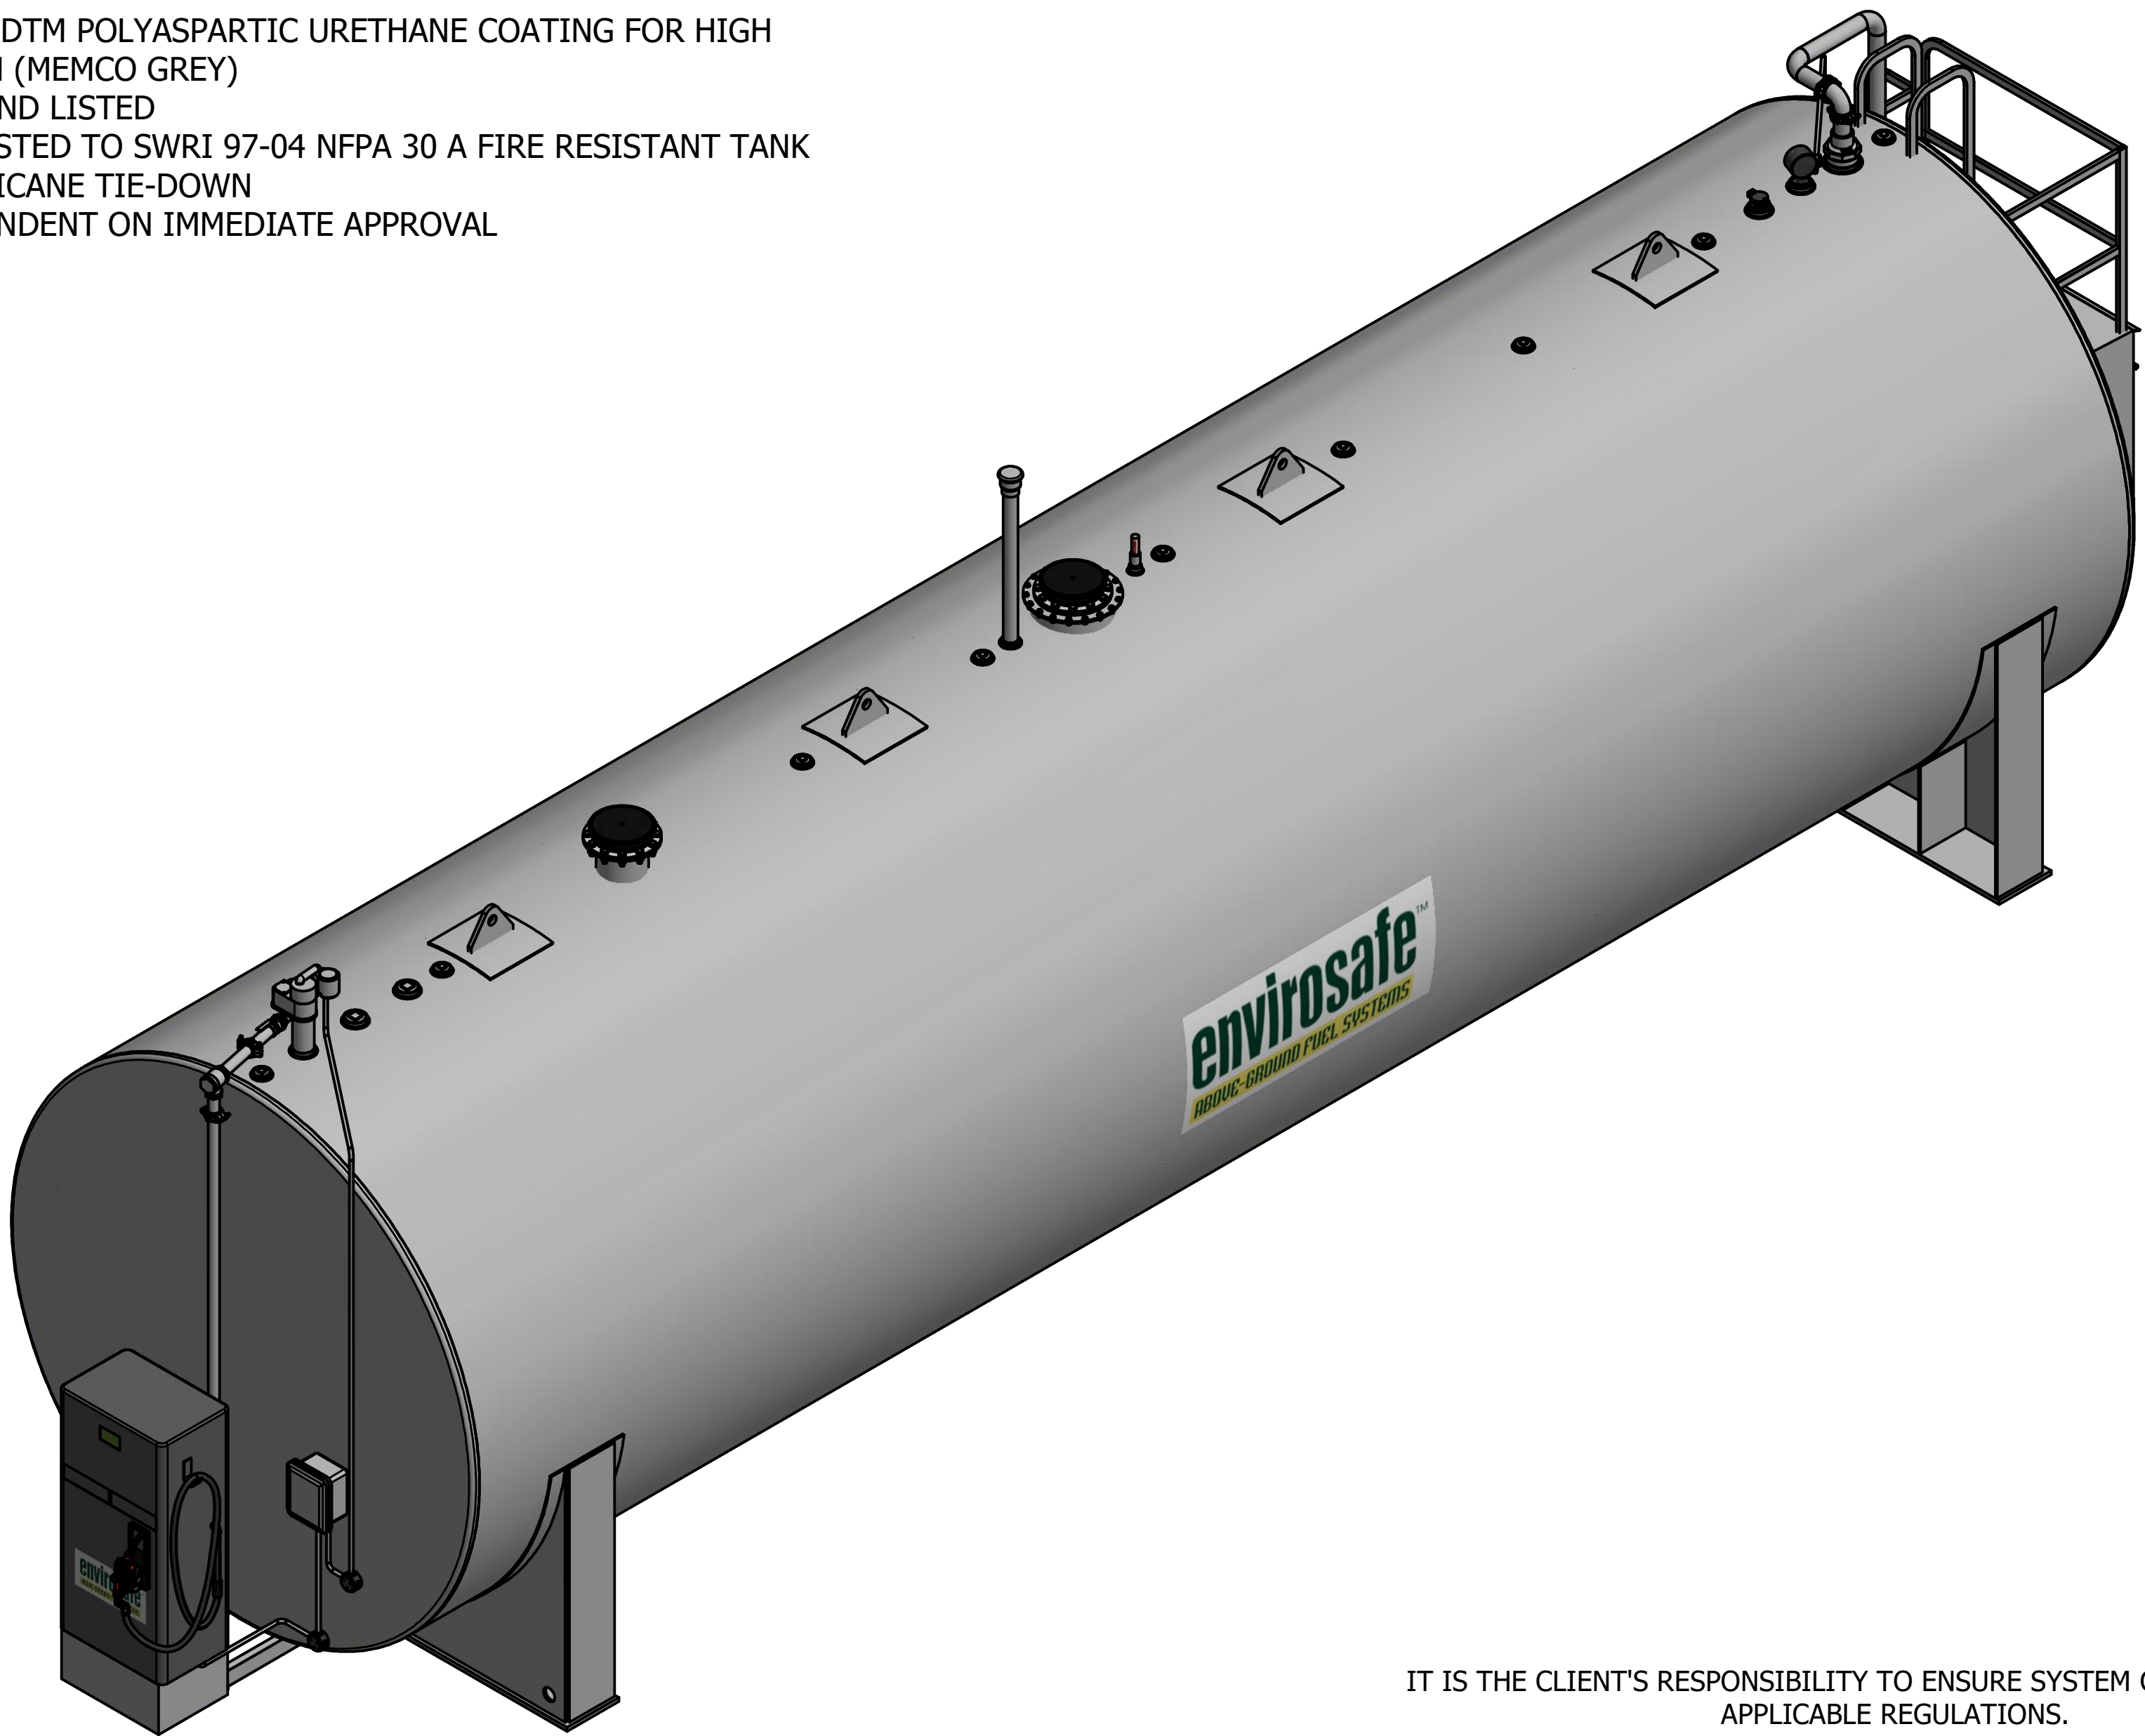

\*LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED DRAWING, WHICH MUST BE RETURNED BEFORE PRODUCTION CAN BEGIN\*

#



STI  
SwRI  
UL

This document and all information and design thereon are the property of Envirosafe Fuel Systems. This document is confidential and must not be made public or copied without written authorization from Envirosafe and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by Envirosafe. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

IT IS THE CLIENT'S RESPONSIBILITY TO ENSURE SYSTEM COMPLIANCE WITH APPLICABLE REGULATIONS.

DRAWN BY AP MEMCO REP	4/15/2020	MEMCO, INC	
QUOTE #25000 GALLON FG DISPENSER		<div>envirosafe™ ABOVE-GROUND FUEL SYSTEMS</div> <div>25,000 GALLON FIREGUARD DISPENSER SYSTEM</div>	
Customer Approval Signature			
CUSTOMER REQUESTED COMPLETION DATE :		SIZE C	DWG NO 25000 GALLON FG DISPENSER
		SCALE	REV
			SHEET 1 OF 5

PARTS LIST			PARTS LIST		
ITEM	QTY	DESCRIPTION	ITEM	QTY	DESCRIPTION
1	1	25,000 GALLON FIREGUARD TANK MOUNTED ON SADDLES	15	1	VALVE EMERGENCY SHUT-OFF 2"X1.5" CONTAINMENT BODY STYLE
2	1	18" MANWAY FOR EASY INNER TANK ACCESSIBILITY	16	1	FE PETRO 3/4 HP w/RISER, 88IN - 149IN (240V 1 PH)
3	1	6 IN NPT THREADED FLANGE	17	1	2" ANTI-SYPHON VALVE
4	5	4 IN NPT THREADED FLANGE	18	1	VALVE BALL 2IN
5	9	3" NPT THREADED FLANGE (CONCRETE PORT)	19	1	DISPENSER BENNETT SINGLE PRODUCT 3711SNR-18-J-P-SO DISPENSER w/10:1 PULSER (ENVIROSAFE LOGO ON DOOR)
6	1	3 IN NPT THREADED FLANGE	20	1	ENCLOSURE ADALET HAZ LOC TYPE 4/7/9 8"X10"X6" W/ PAN & HINGES W/ 3- 1/2" NPT CONDUIT
7	2	2 IN NPT THREADED FLANGE	21	1	3" UPDRAFT STACK W/3" 354 SLIP ON
8	2	10" 8 OZ. FLANGE E-VENT KIT	22	1	INTERSTITIAL LEAK GAUGE
9	4	LIFTING LUG	23	1	3" GROUND LEVEL FILL WITH DUST CAP AND ADAPTOR
10	1	UL LISTED LOCKABLE 3'6"x4'2"x4' FILL BOX, CROSS BROKEN FOR EASY DRAINAGE, 2" STACK VENT AND 1/2" BALL VALVE	24	1	ROM DOOR 3'x3'
11	1	3" OVERFILL PREVENTION VALVE WITH TEST MECHANISM AND DIFFUSER	25	1	TANK DECAL KIT (NOT SHOWN)
12	1	STEP LADDER TO ACCESS TOP OF TANK WITH HANDRAIL SYSTEM AND SAFETY SHIELD	26	1	TOUCH UP PAINT (NOT SHOWN AND SHIPPED SEPARATELY)
13	1	918 CLOCK GAUGE WITH ALARM BOX & STANDARD FLOAT			
14	1	MONITORING CAP 2"			

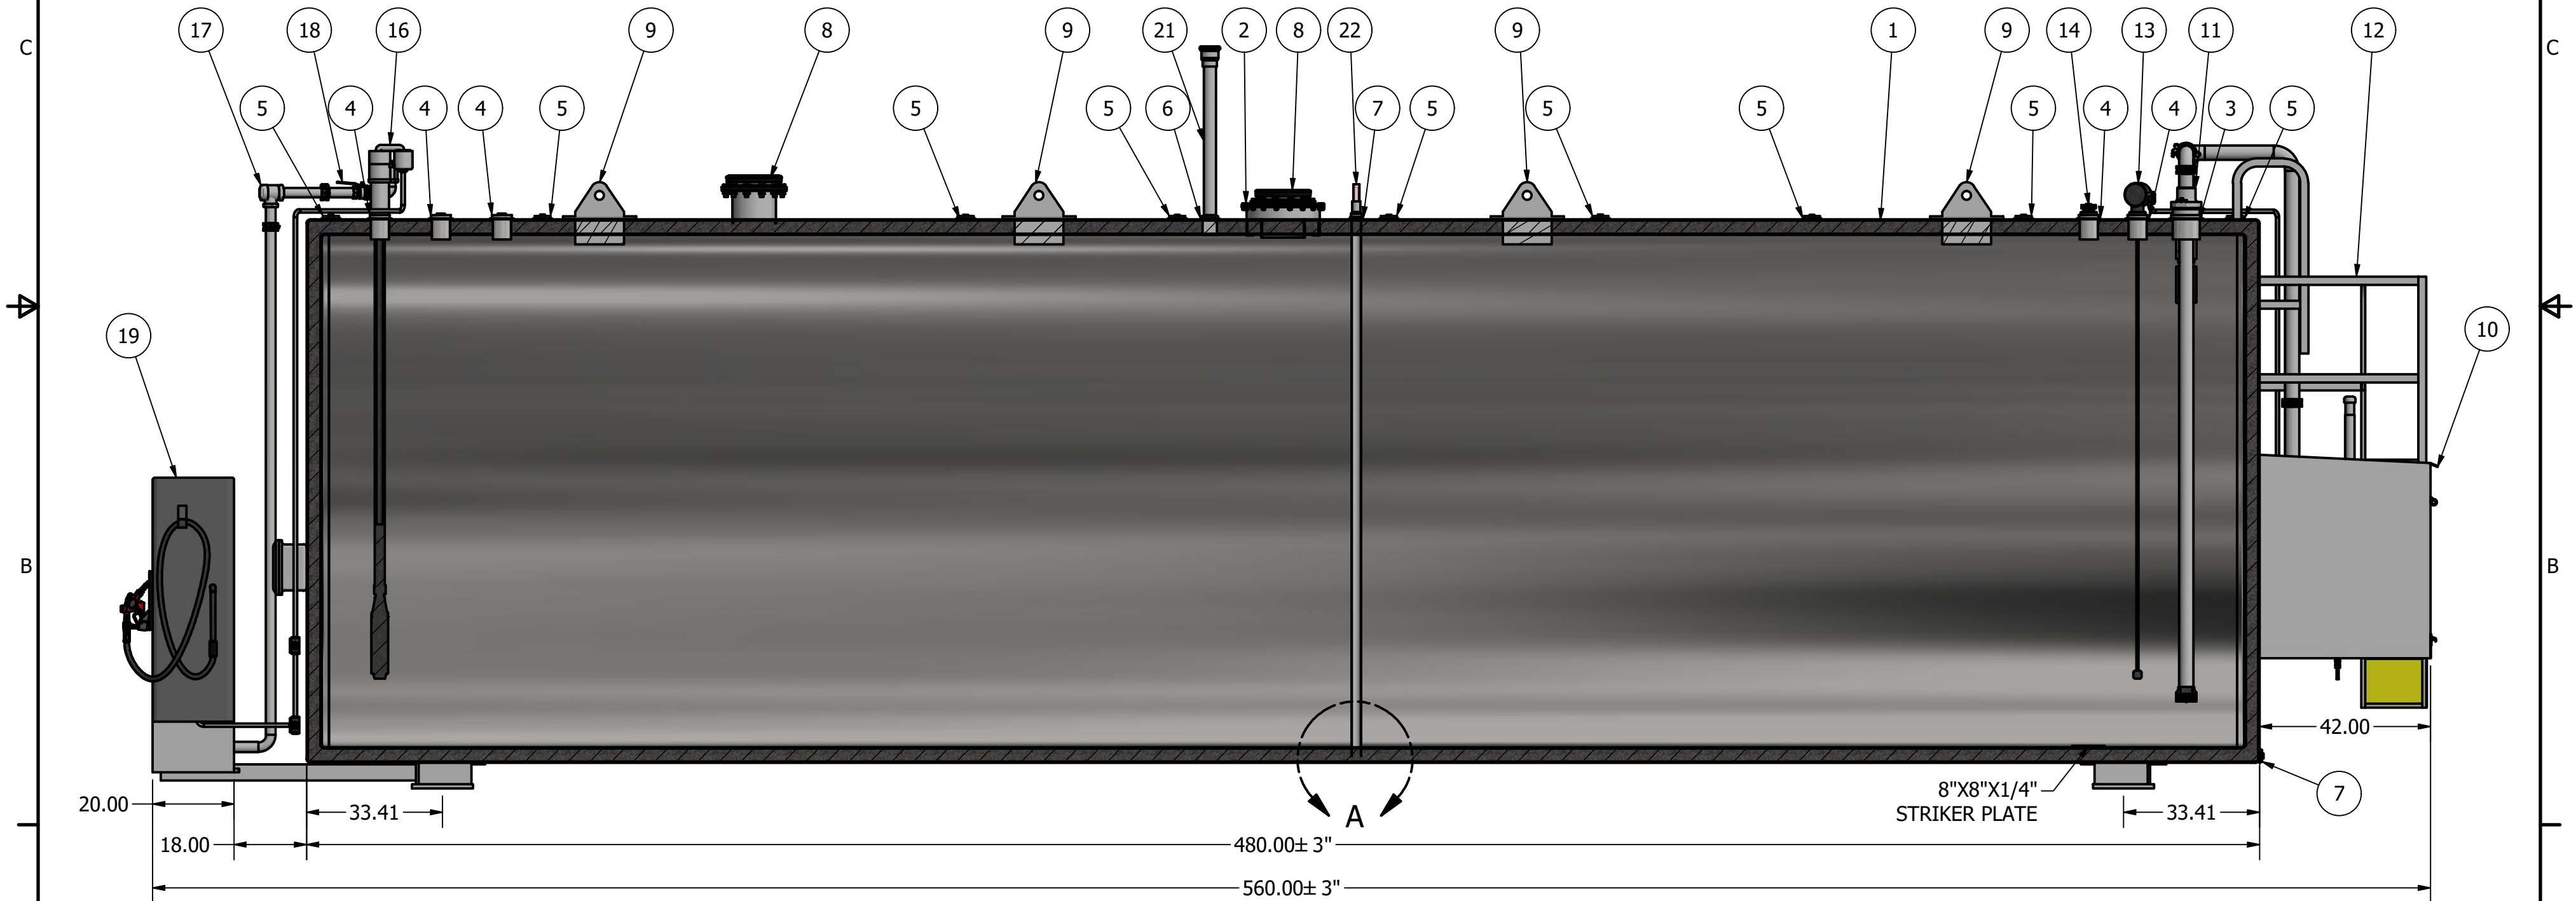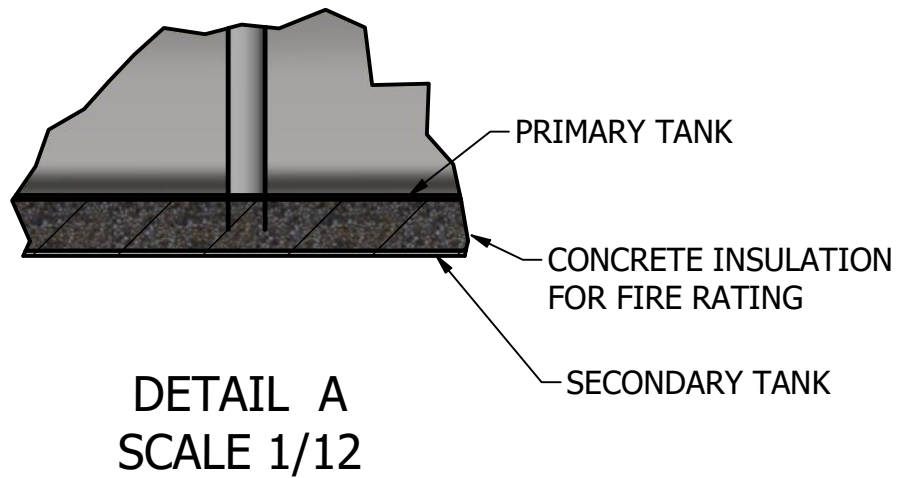

\*LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED DRAWING, WHICH MUST BE RETURNED BEFORE PRODUCTION CAN BEGIN\*

#


SHELL THICKNESS: 5/16"  
HEAD THICKNESS: 5/16"

STI  
SwRI  
UL

IT IS THE CLIENT'S RESPONSIBILITY TO ENSURE SYSTEM COMPLIANCE WITH APPLICABLE REGULATIONS.

DRAWN BY AP MEMCO REP	4/15/2020	MEMCO, INC	
QUOTE # 25000 GALLON FG DISPENSER		25,000 GALLON FIREGUARD DISPENSER SYSTEM	
Customer Approval Signature		SIZE C	REV
		SCALE	25000 GALLON FG DISPENSER
		SHEET 2 OF 5	

This document and all information and design thereon are the property of EnviroSAFE Fuel Systems. This document is confidential and must not be made public or copied without written authorization from EnviroSAFE and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by EnviroSAFE. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

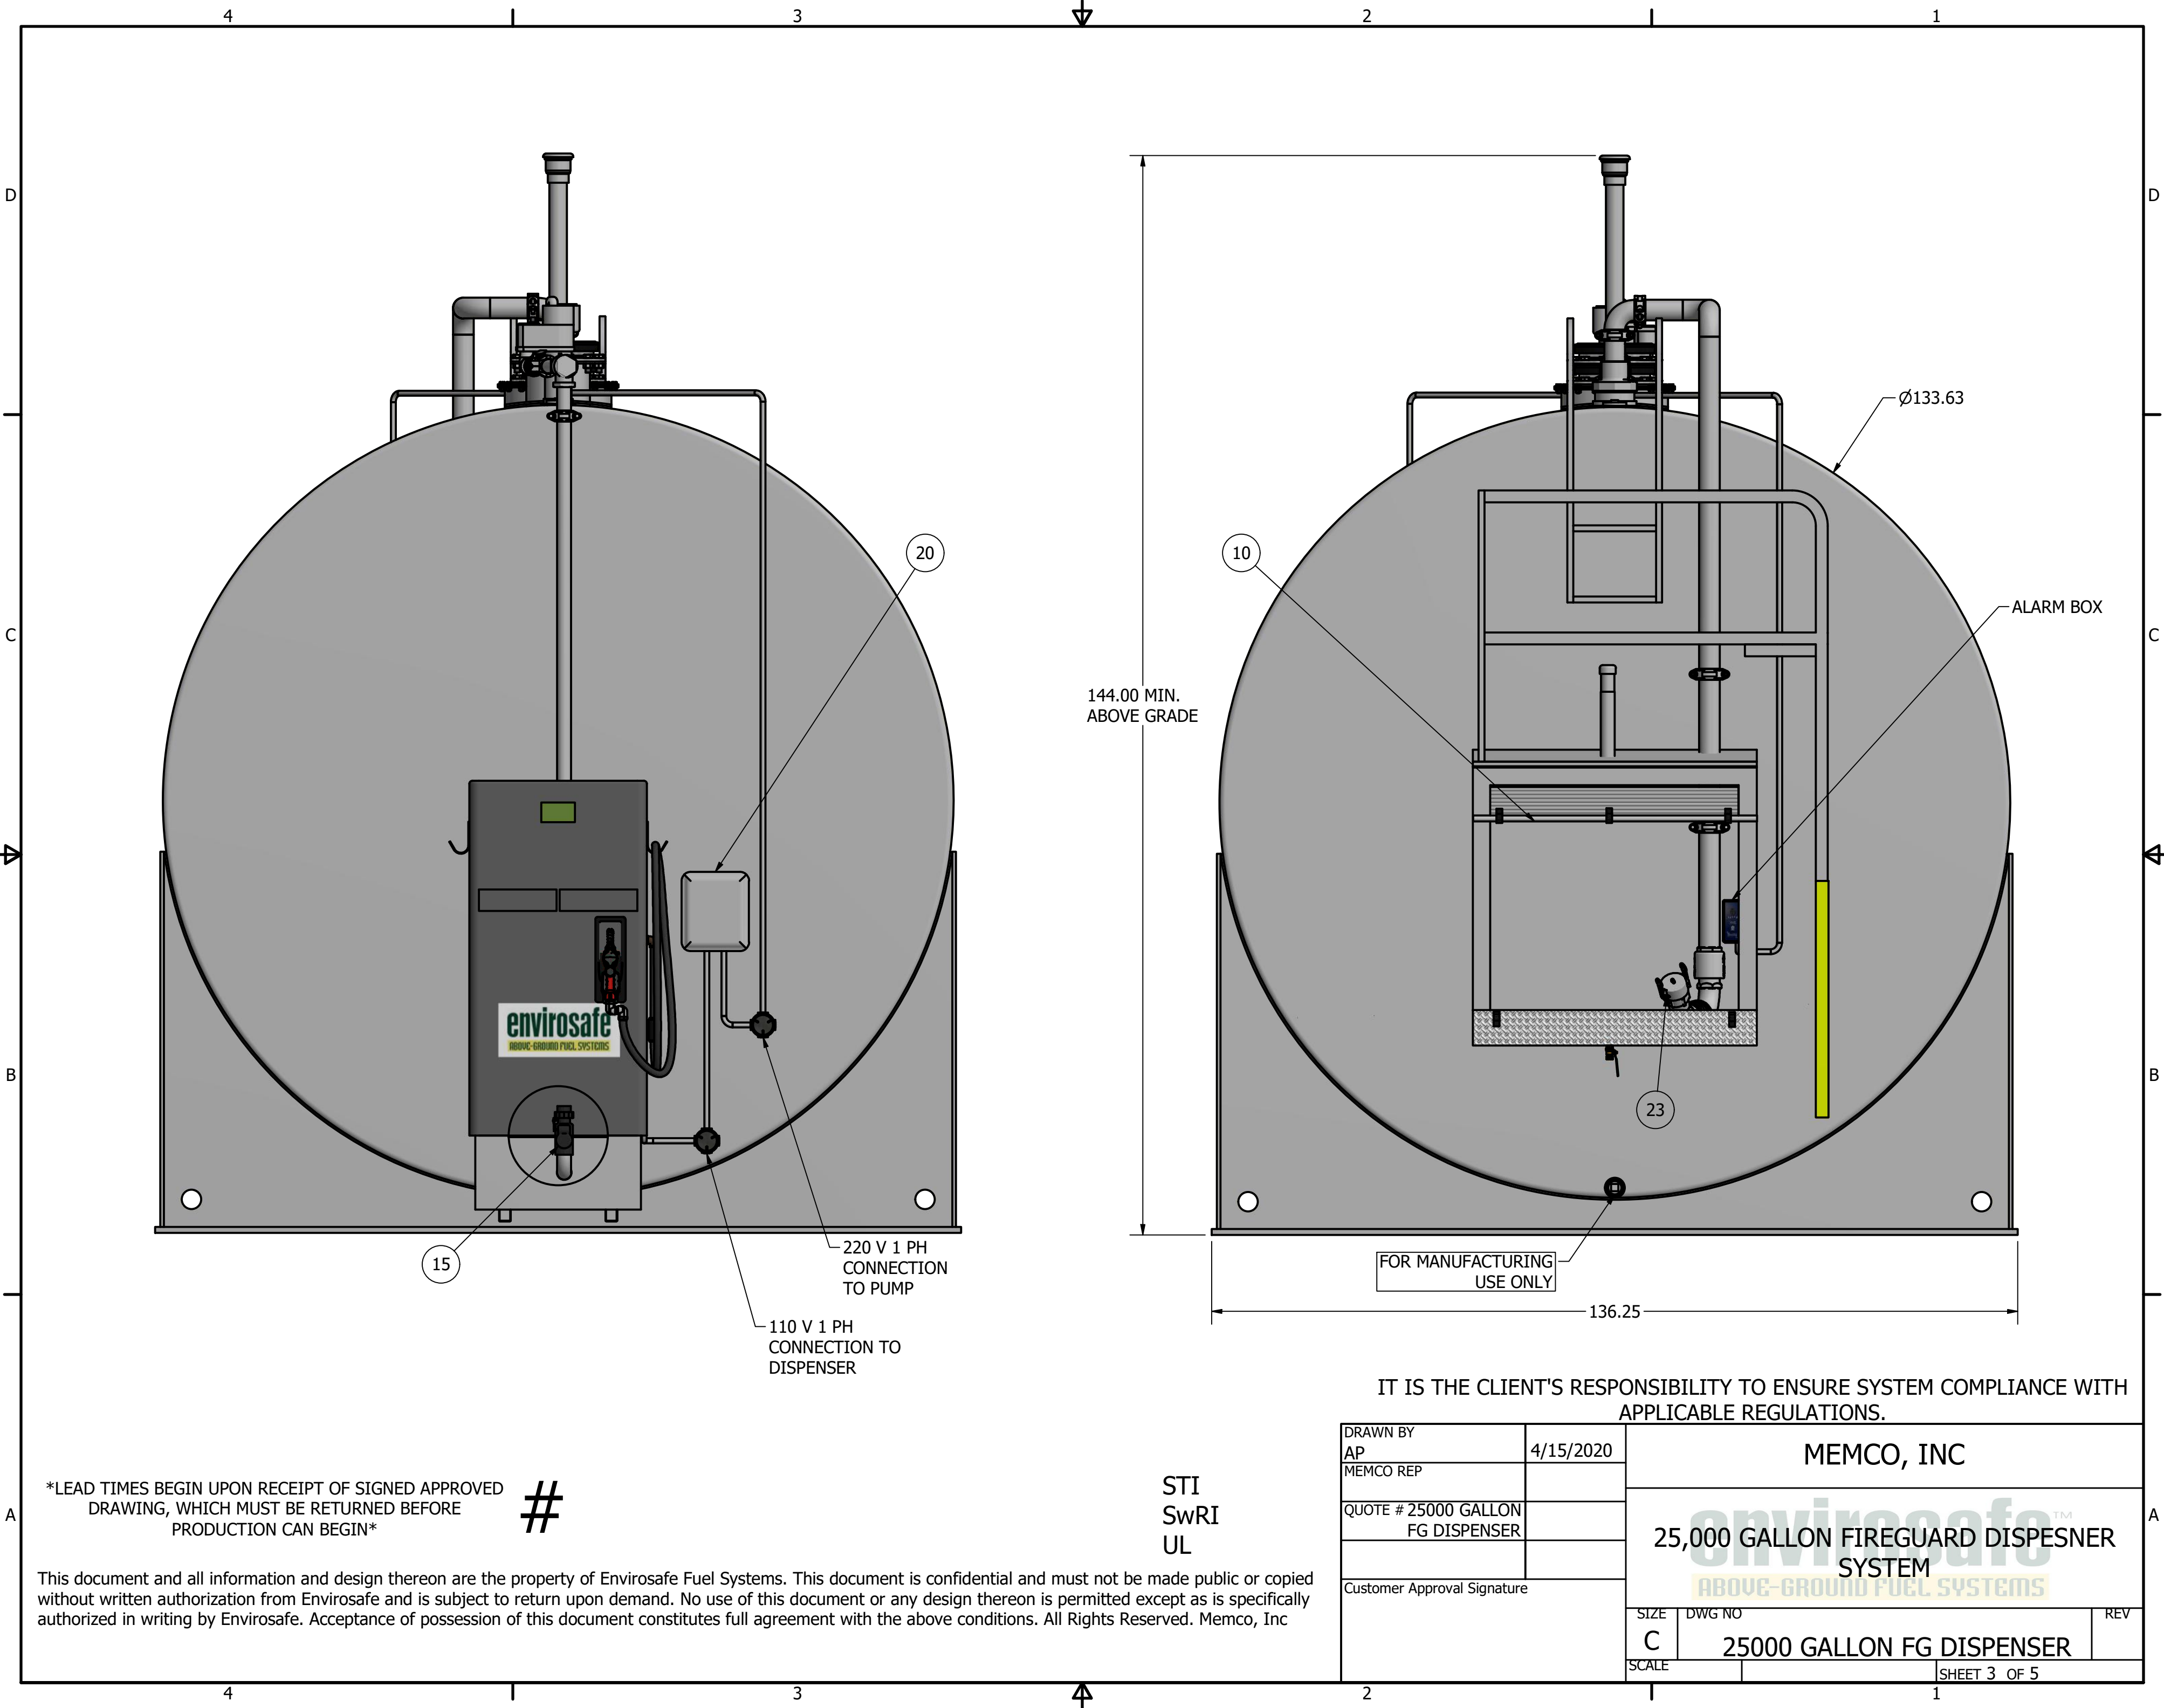


\*LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED  
DRAWING, WHICH MUST BE RETURNED BEFORE  
PRODUCTION CAN BEGIN\*


#

This document and all information and design thereon are the property of Envirosafe Fuel Systems. This document is confidential and must not be made public or copied without written authorization from Envirosafe and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by Envirosafe. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

STI  
SwRI  
UL

IT IS THE CLIENT'S RESPONSIBILITY TO ENSURE SYSTEM COMPLIANCE WITH  
APPLICABLE REGULATIONS.

DRAWN BY AP MEMCO REP	4/15/2020	MEMCO, INC	
QUOTE # 25000 GALLON FG DISPENSER		 25,000 GALLON FIREGUARD DISPENSER SYSTEM	
Customer Approval Signature			
SIZE C	DWG NO	25000 GALLON FG DISPENSER	REV
SCALE		SHEET 3 OF 5	

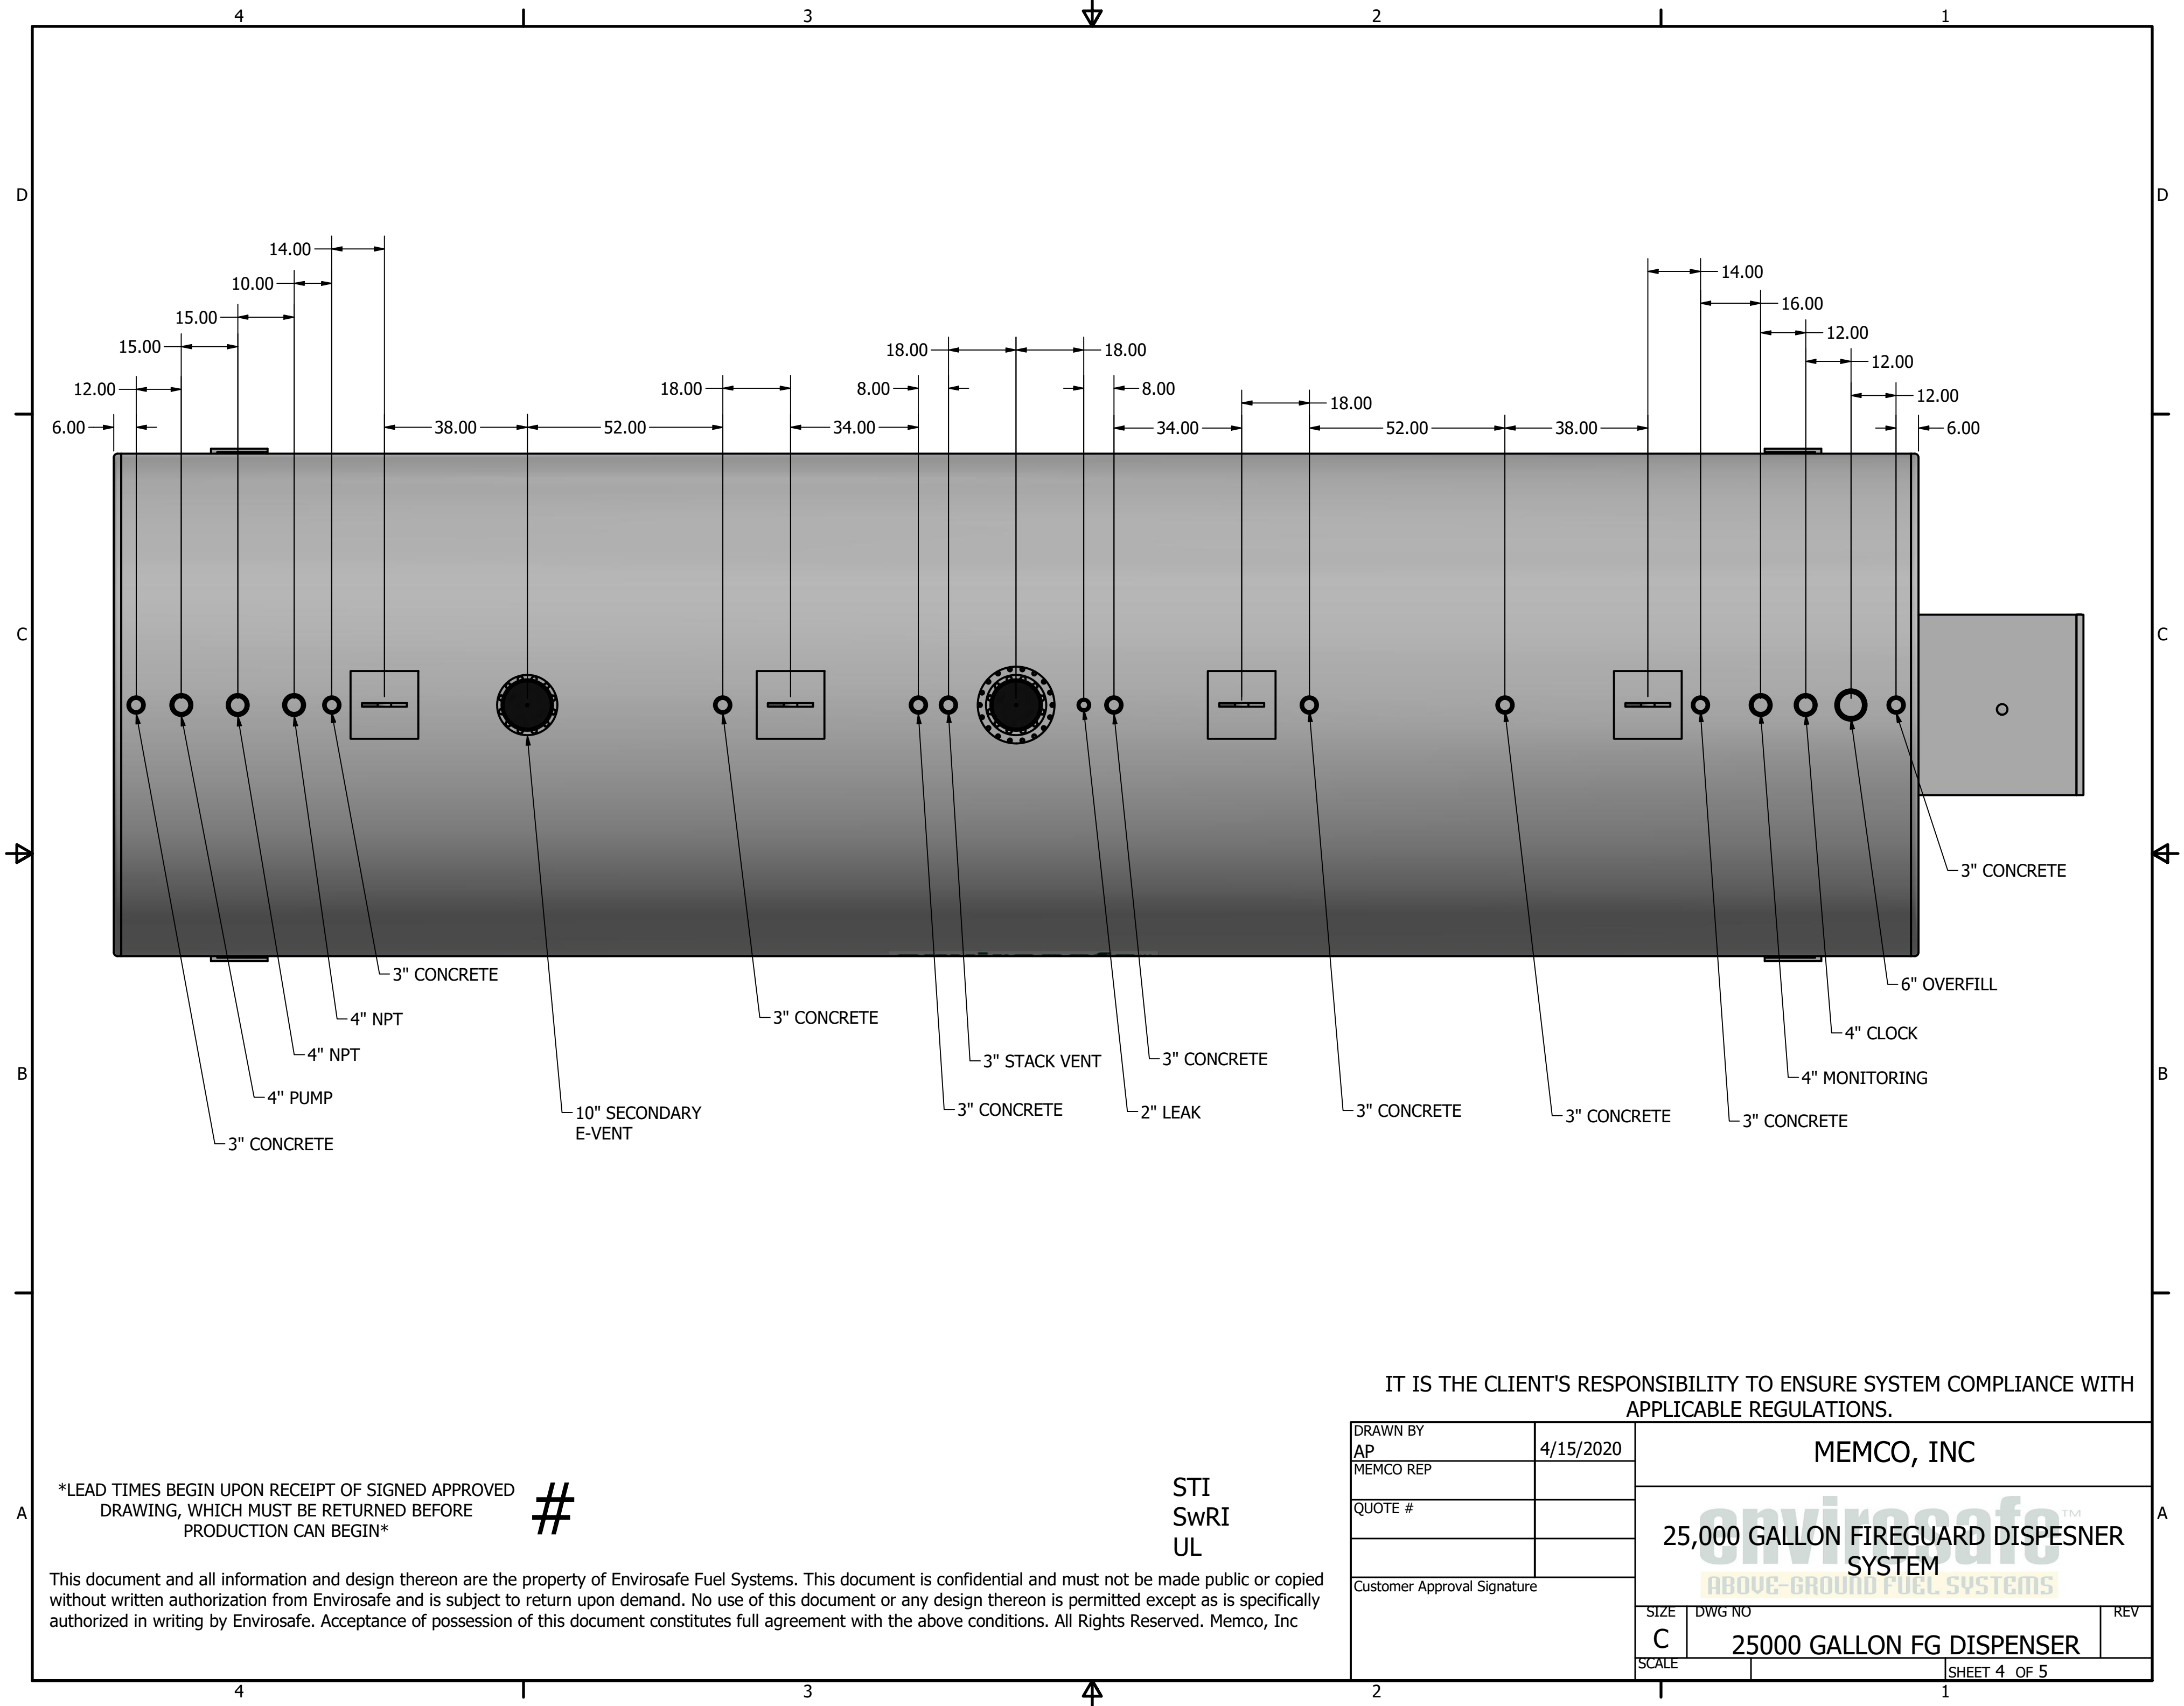

\*LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED DRAWING, WHICH MUST BE RETURNED BEFORE PRODUCTION CAN BEGIN\*

#

This document and all information and design thereon are the property of Envirosafe Fuel Systems. This document is confidential and must not be made public or copied without written authorization from Envirosafe and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by Envirosafe. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

STI  
SwRI  
UL

IT IS THE CLIENT'S RESPONSIBILITY TO ENSURE SYSTEM COMPLIANCE WITH APPLICABLE REGULATIONS.

DRAWN BY AP	4/15/2020	MEMCO, INC	
MEMCO REP		<div>envirosafe™</div> <div>25,000 GALLON FIREGUARD DISPENSER SYSTEM</div> <div>ABOVE-GROUND FUEL SYSTEMS</div>	
QUOTE #			
Customer Approval Signature		SIZE C	DWG NO 25000 GALLON FG DISPENSER
		SCALE	REV
		SHEET 4 OF 5	

PARTS LIST		
ITEM	QTY	PART NUMBER
1	1	25,000 GALLON FIREGUARD TANK MOUNTED ON SADDLES
2	1	18" MANWAY FOR EASY INNER TANK ACCESSIBILITY
3	1	6 IN NPT THREADED FLANGE
4	5	4 IN NPT THREADED FLANGE
5	9	3" NPT THREADED FLANGE (CONCRETE PORT)
6	1	3 IN NPT THREADED FLANGE
7	2	2 IN NPT THREADED FLANGE
8	2	10" 8 OZ. FLANGE E-VENT KIT
9	4	LIFTING LUG
10	1	UL LISTED LOCKABLE 3'6"x4'2"x4' FILL BOX, CROSS BROKEN FOR EASY DRAINAGE, 2" STACK VENT AND 1/2" BALL VALVE
11	1	3" OVERFILL PREVENTION VALVE WITH TEST MECHANISM AND DIFFUSER
12	1	STEP LADDER TO ACCESS TOP OF TANK WITH HANDRAIL SYSTEM AND SAFETY SHIELD
13	1	918 CLOCK GAUGE WITH ALARM BOX & STANDARD FLOAT
14	1	MONITORING CAP 2"
15	1	VALVE EMERGENCY SHUT-OFF 2"x1.5" CONTAINMENT BODY STYLE
16	1	FE PETRO 3/4 HP w/RISER, 88IN - 149IN (240V 1 PH)
17	1	2" ANTI-SYPHON VALVE
18	1	VALVE BALL 2IN
19	1	DISPENSER BENNETT SINGLE PRODUCT 3711SNR-18-J-P-SO DISPENSER w/10:1 PULSER (ENVIROSAFE LOGO ON DOOR)
20	1	ENCLOSURE ADALET HAZ LOC TYPE 4/7/9 8"x10"x6" W/ PAN & HINGES W/ 3- 1/2" NPT CONDUIT
21	1	3" UPDRAFT STACK W/3" 354 SLIP ON
22	1	INTERSTITIAL LEAK GAUGE
23	1	3" GROUND LEVEL FILL WITH DUST CAP AND ADAPTOR
24	1	ROM DOOR 3'x3'
25	1	TANK DECAL KIT (NOT SHOWN)
26	1	TOUCH UP PAINT (NOT SHOWN AND SHIPPED SEPARATELY)

IT IS THE CLIENT'S RESPONSIBILITY TO ENSURE SYSTEM COMPLIANCE WITH APPLICABLE REGULATIONS.

DRAWN BY AP	4/15/2020	MEMCO, INC	
MEMCO REP		<div>envirosafe™</div> <div>25,000 GALLON FIREGUARD DISPESENER SYSTEM</div> <div>ABOVE-GROUND FUEL SYSTEMS</div>	
QUOTE #			
Customer Approval Signature		SIZE C	DWG NO 25000 GALLON FG DISPENSER
		SCALE	REV
		SHEET 5 OF 5	

\*LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED DRAWING, WHICH MUST BE RETURNED BEFORE PRODUCTION CAN BEGIN\*

#

STI  
SwRI  
UL

This document and all information and design thereon are the property of Envirosafe Fuel Systems. This document is confidential and must not be made public or copied without written authorization from Envirosafe and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by Envirosafe. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc