

- NOTES:
- 1. GAS/DIESEL USE
  - 2. ENVIROLASTIC 940 DTM POLYASPARTIC URETHANE COATING FOR HIGH PERFORMANCE FINISH (MEMCO GREY)
  - 3. UL 142 LABELED AND LISTED
  - 4. ENGINEERED HURRICANE TIE-DOWN
  - 5. LEAD TIME IS DEPENDENT ON IMMEDIATE APPROVAL



\*LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED  
DRAWING, WHICH MUST BE RETURNED BEFORE  
PRODUCTION CAN BEGIN\*




#19221

STI  
SwRI  
UL

This document and all information and design thereon are the property of EnviroSafe Fuel Systems. This document is confidential and must not be made public or copied without written authorization from EnviroSafe and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by EnviroSafe. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

DRAWN BY AP		9/11/2019		MEMCO, INC	
MEMCO REP					
QUOTE #		TANK#19221		envirosafe™ 500 GALLON FLAMESHIELD (STOCK TANK) ABOVE-GROUND FUEL SYSTEMS	
Customer Approval Signature					
CUSTOMER REQUESTED COMPLETION DATE :		SIZE C	DWG NO TANK#19221		REV
		SCALE			SHEET 1 OF 3

PARTS LIST			
ITEM	QTY	DESCRIPTION	PART NUMBER
1	1	500 GALLON FLAMESHIELD TANK MOUNTED ON SADDLES	500-Gallon-Secondary-Tank-Test
2	1	18" MANWAY FOR EASY INNER TANK ACCESSIBILITY	P-18" MANWAY - 10
3	5	4 IN NPT THREADED FLANGE	P-SERIES 262
4	4	2 IN NPT THREADED FLANGE	P-SERIES 158
5	1	LIFTING LUG	LIFTING LUG SMALL

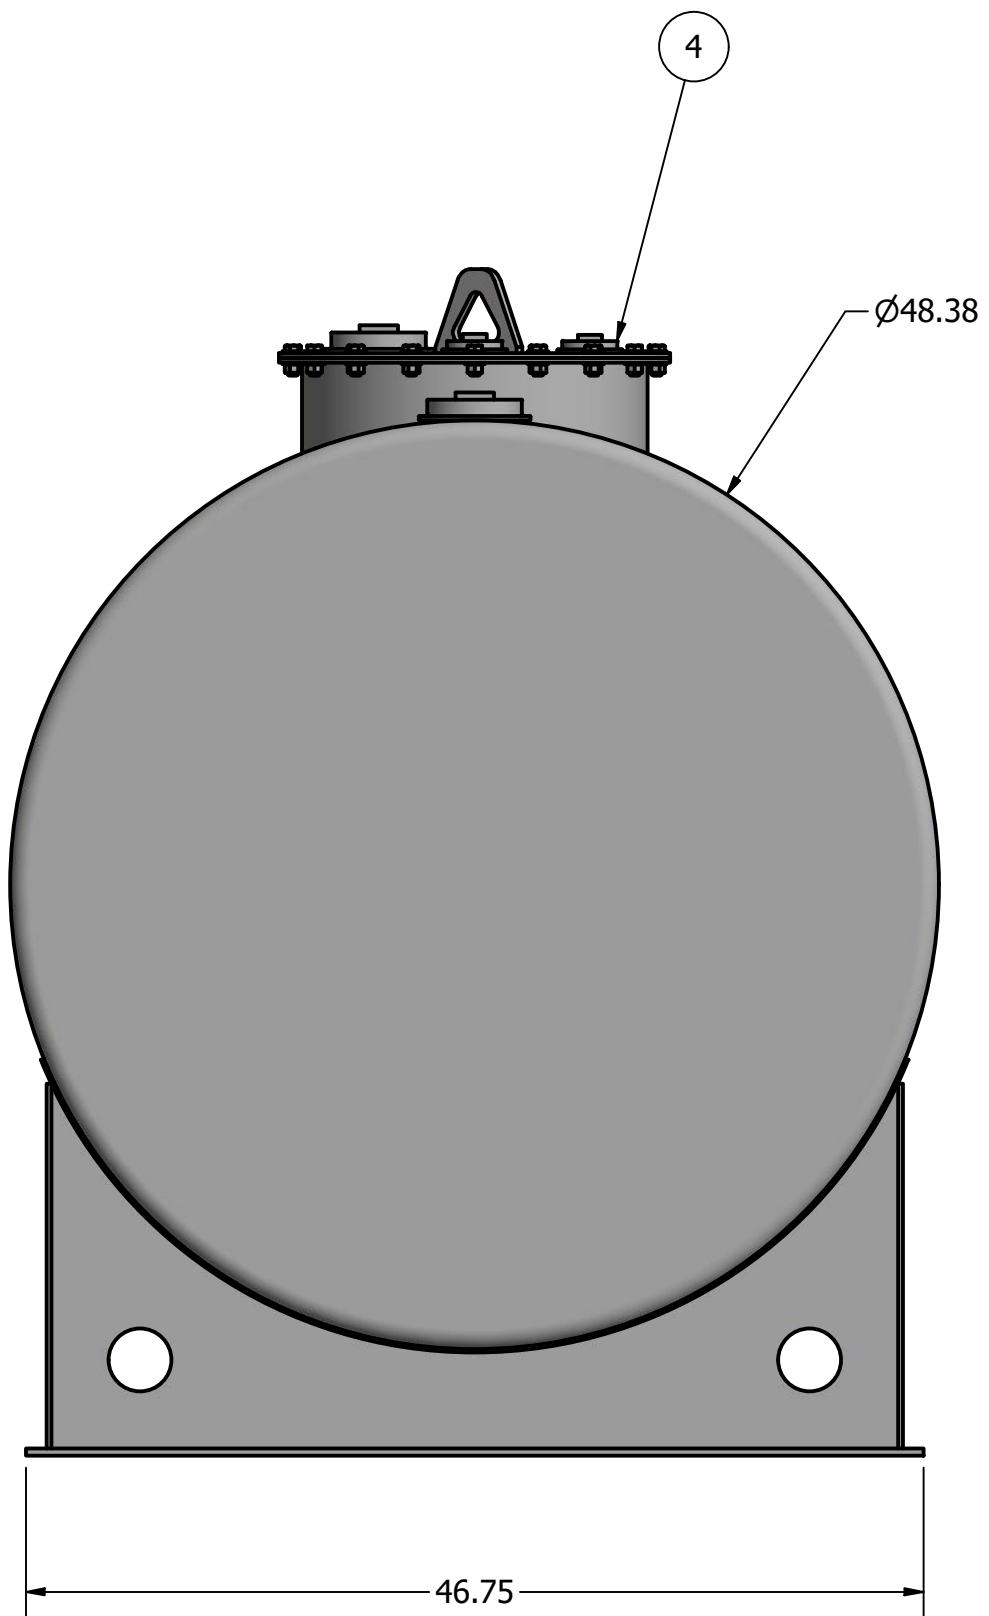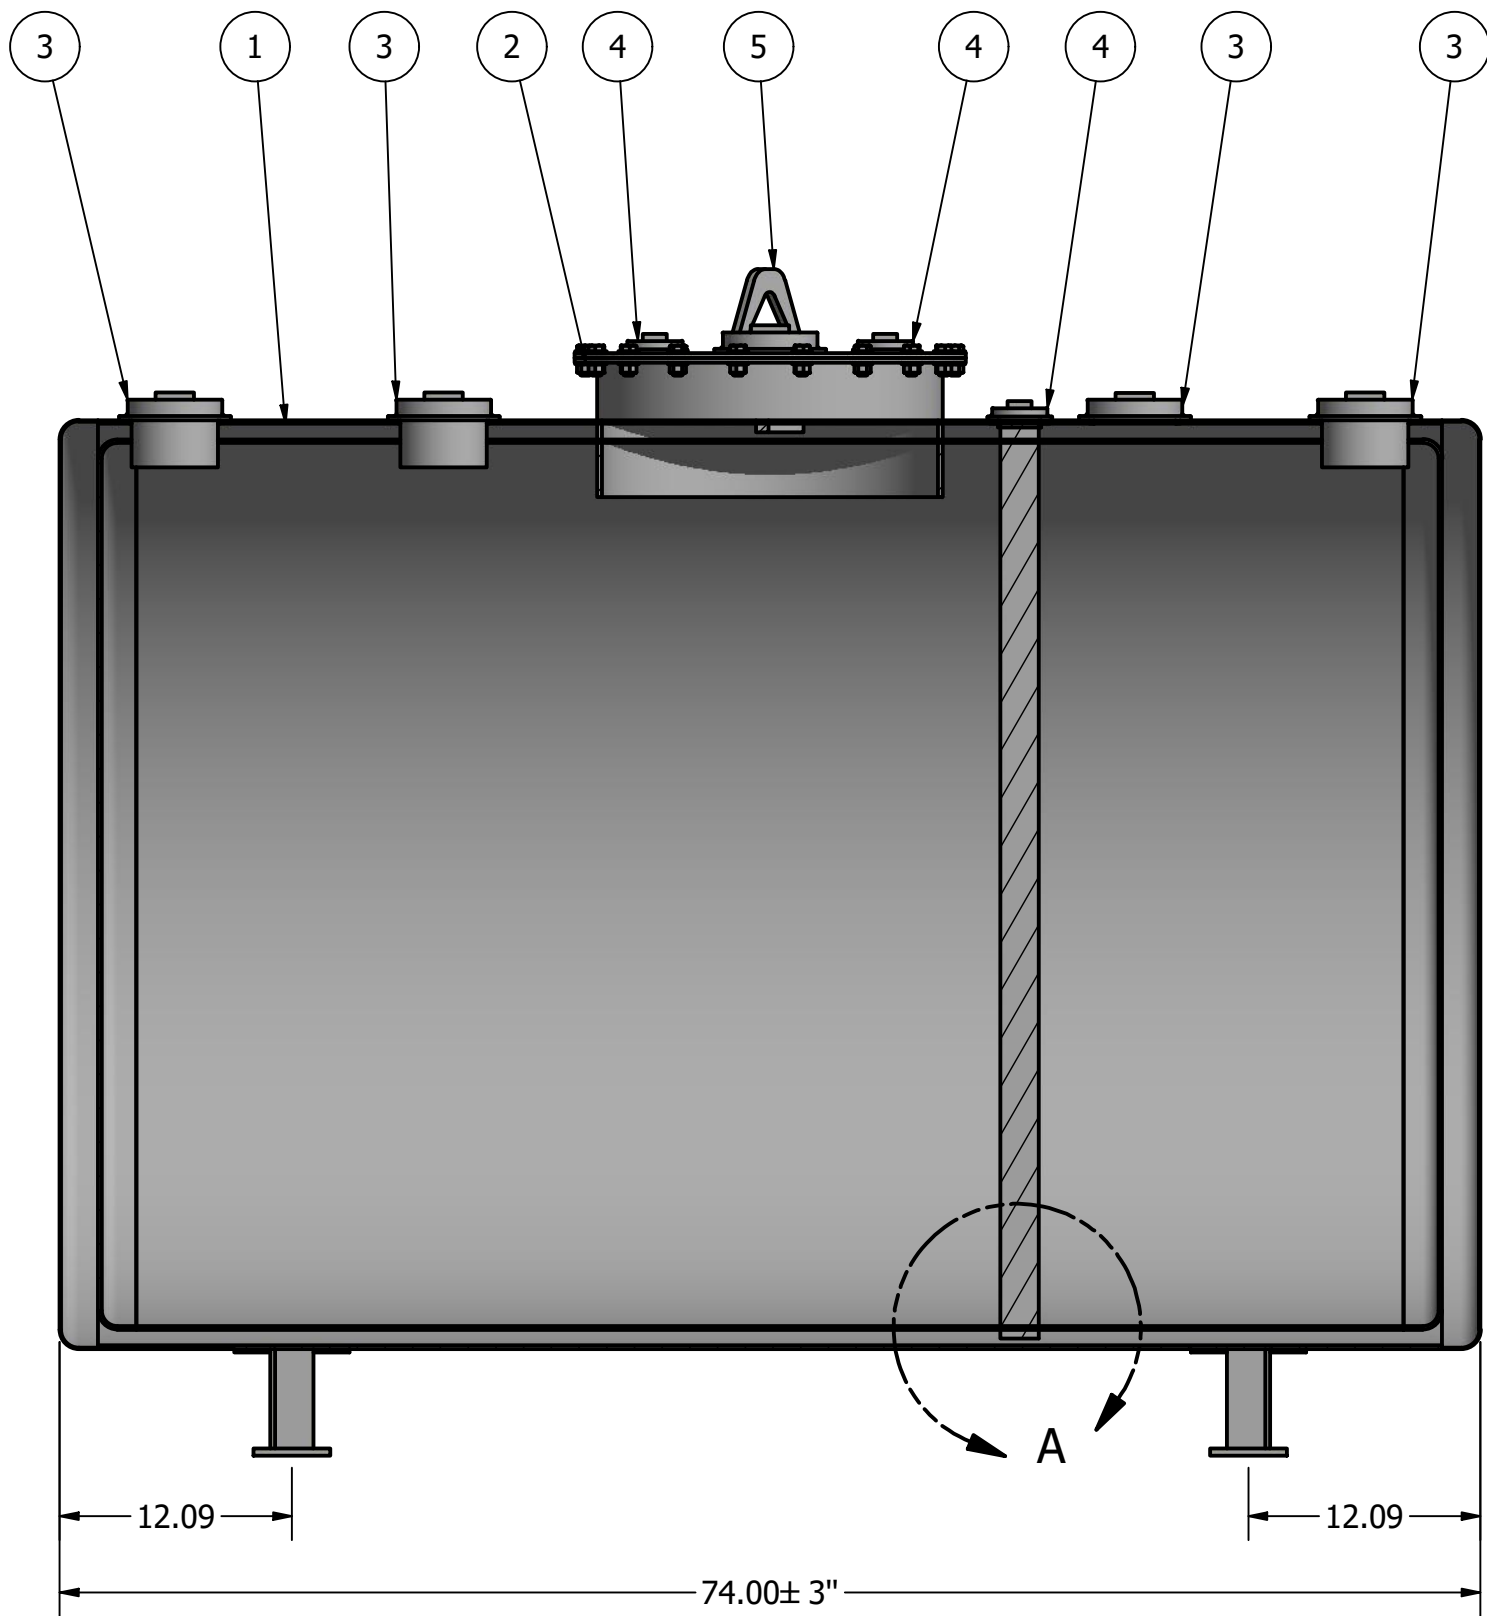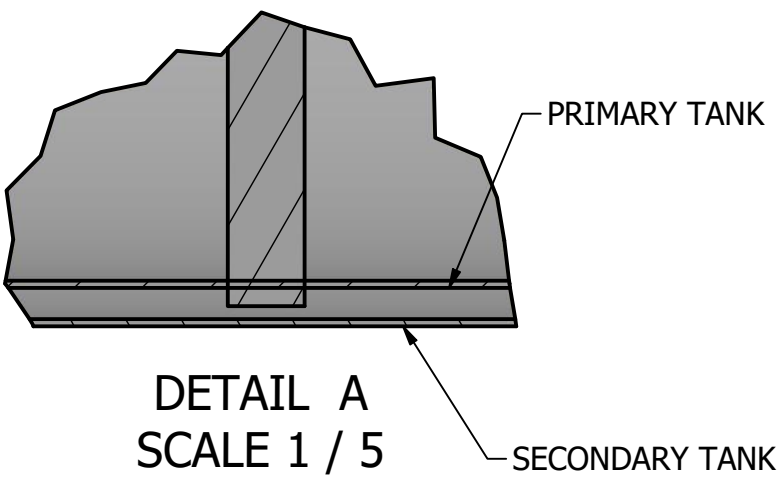


\*LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED  
DRAWING, WHICH MUST BE RETURNED BEFORE  
PRODUCTION CAN BEGIN\*



#19221

SHELL THICKNESS: 3/16"  
HEAD THICKNESS: 1/4"

STI  
SwRI  
UL

This document and all information and design thereon are the property of Envirosafe Fuel Systems. This document is confidential and must not be made public or copied without written authorization from Envirosafe and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by Envirosafe. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

DRAWN BY AP	9/11/2019	MEMCO, INC	
MEMCO REP		 500 GALLON FLAMESHIELD (STOCK TANK)	
QUOTE #	TANK#19221		
Customer Approval Signature		SIZE C	DWG NO TANK#19221
		SCALE	REV
			SHEET 2 OF 3

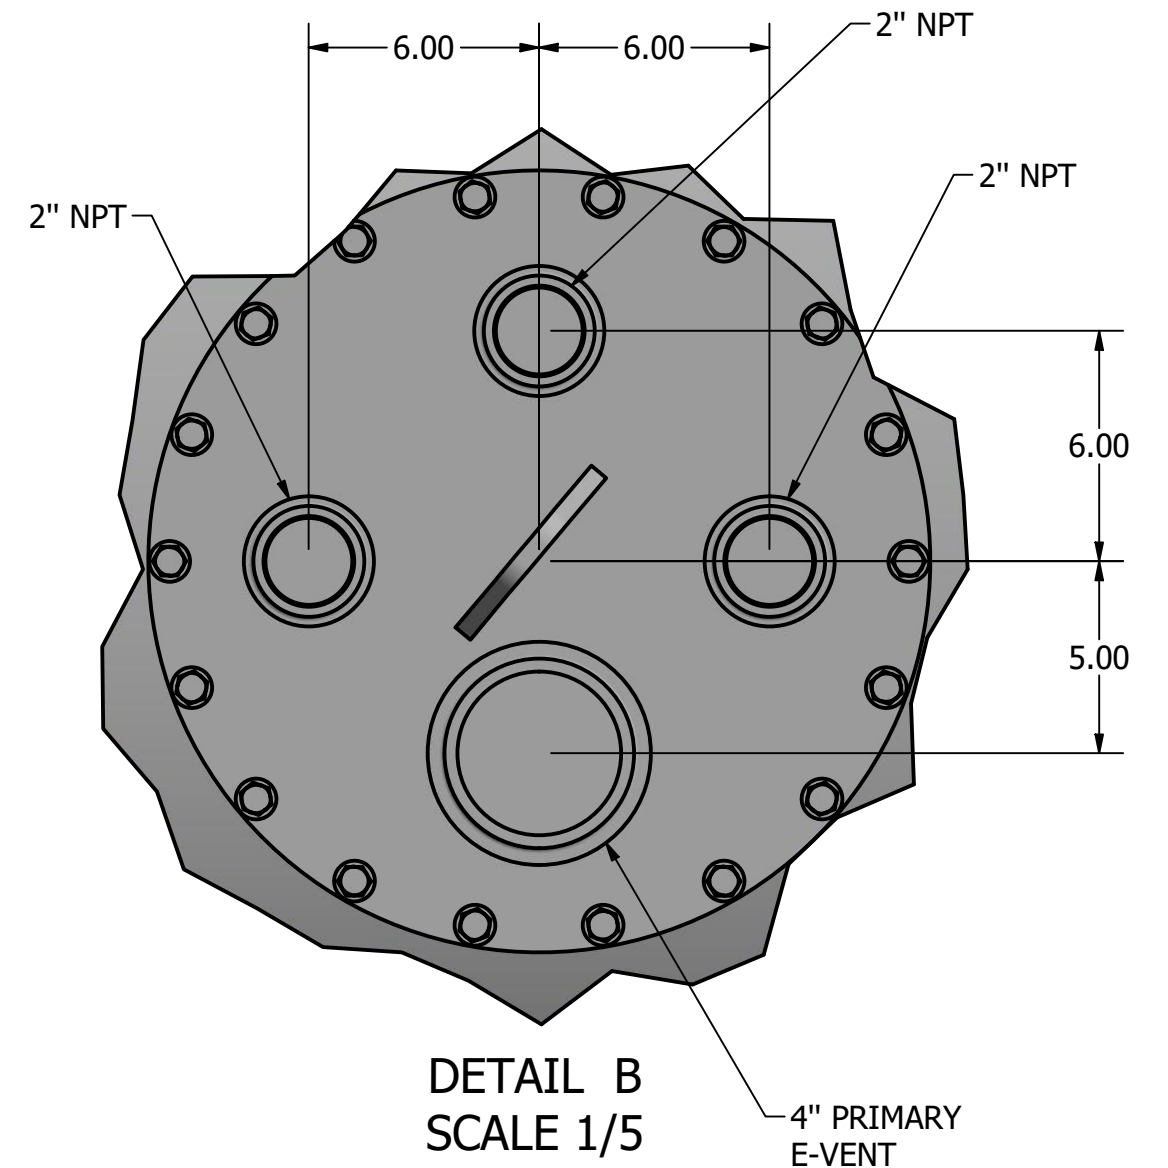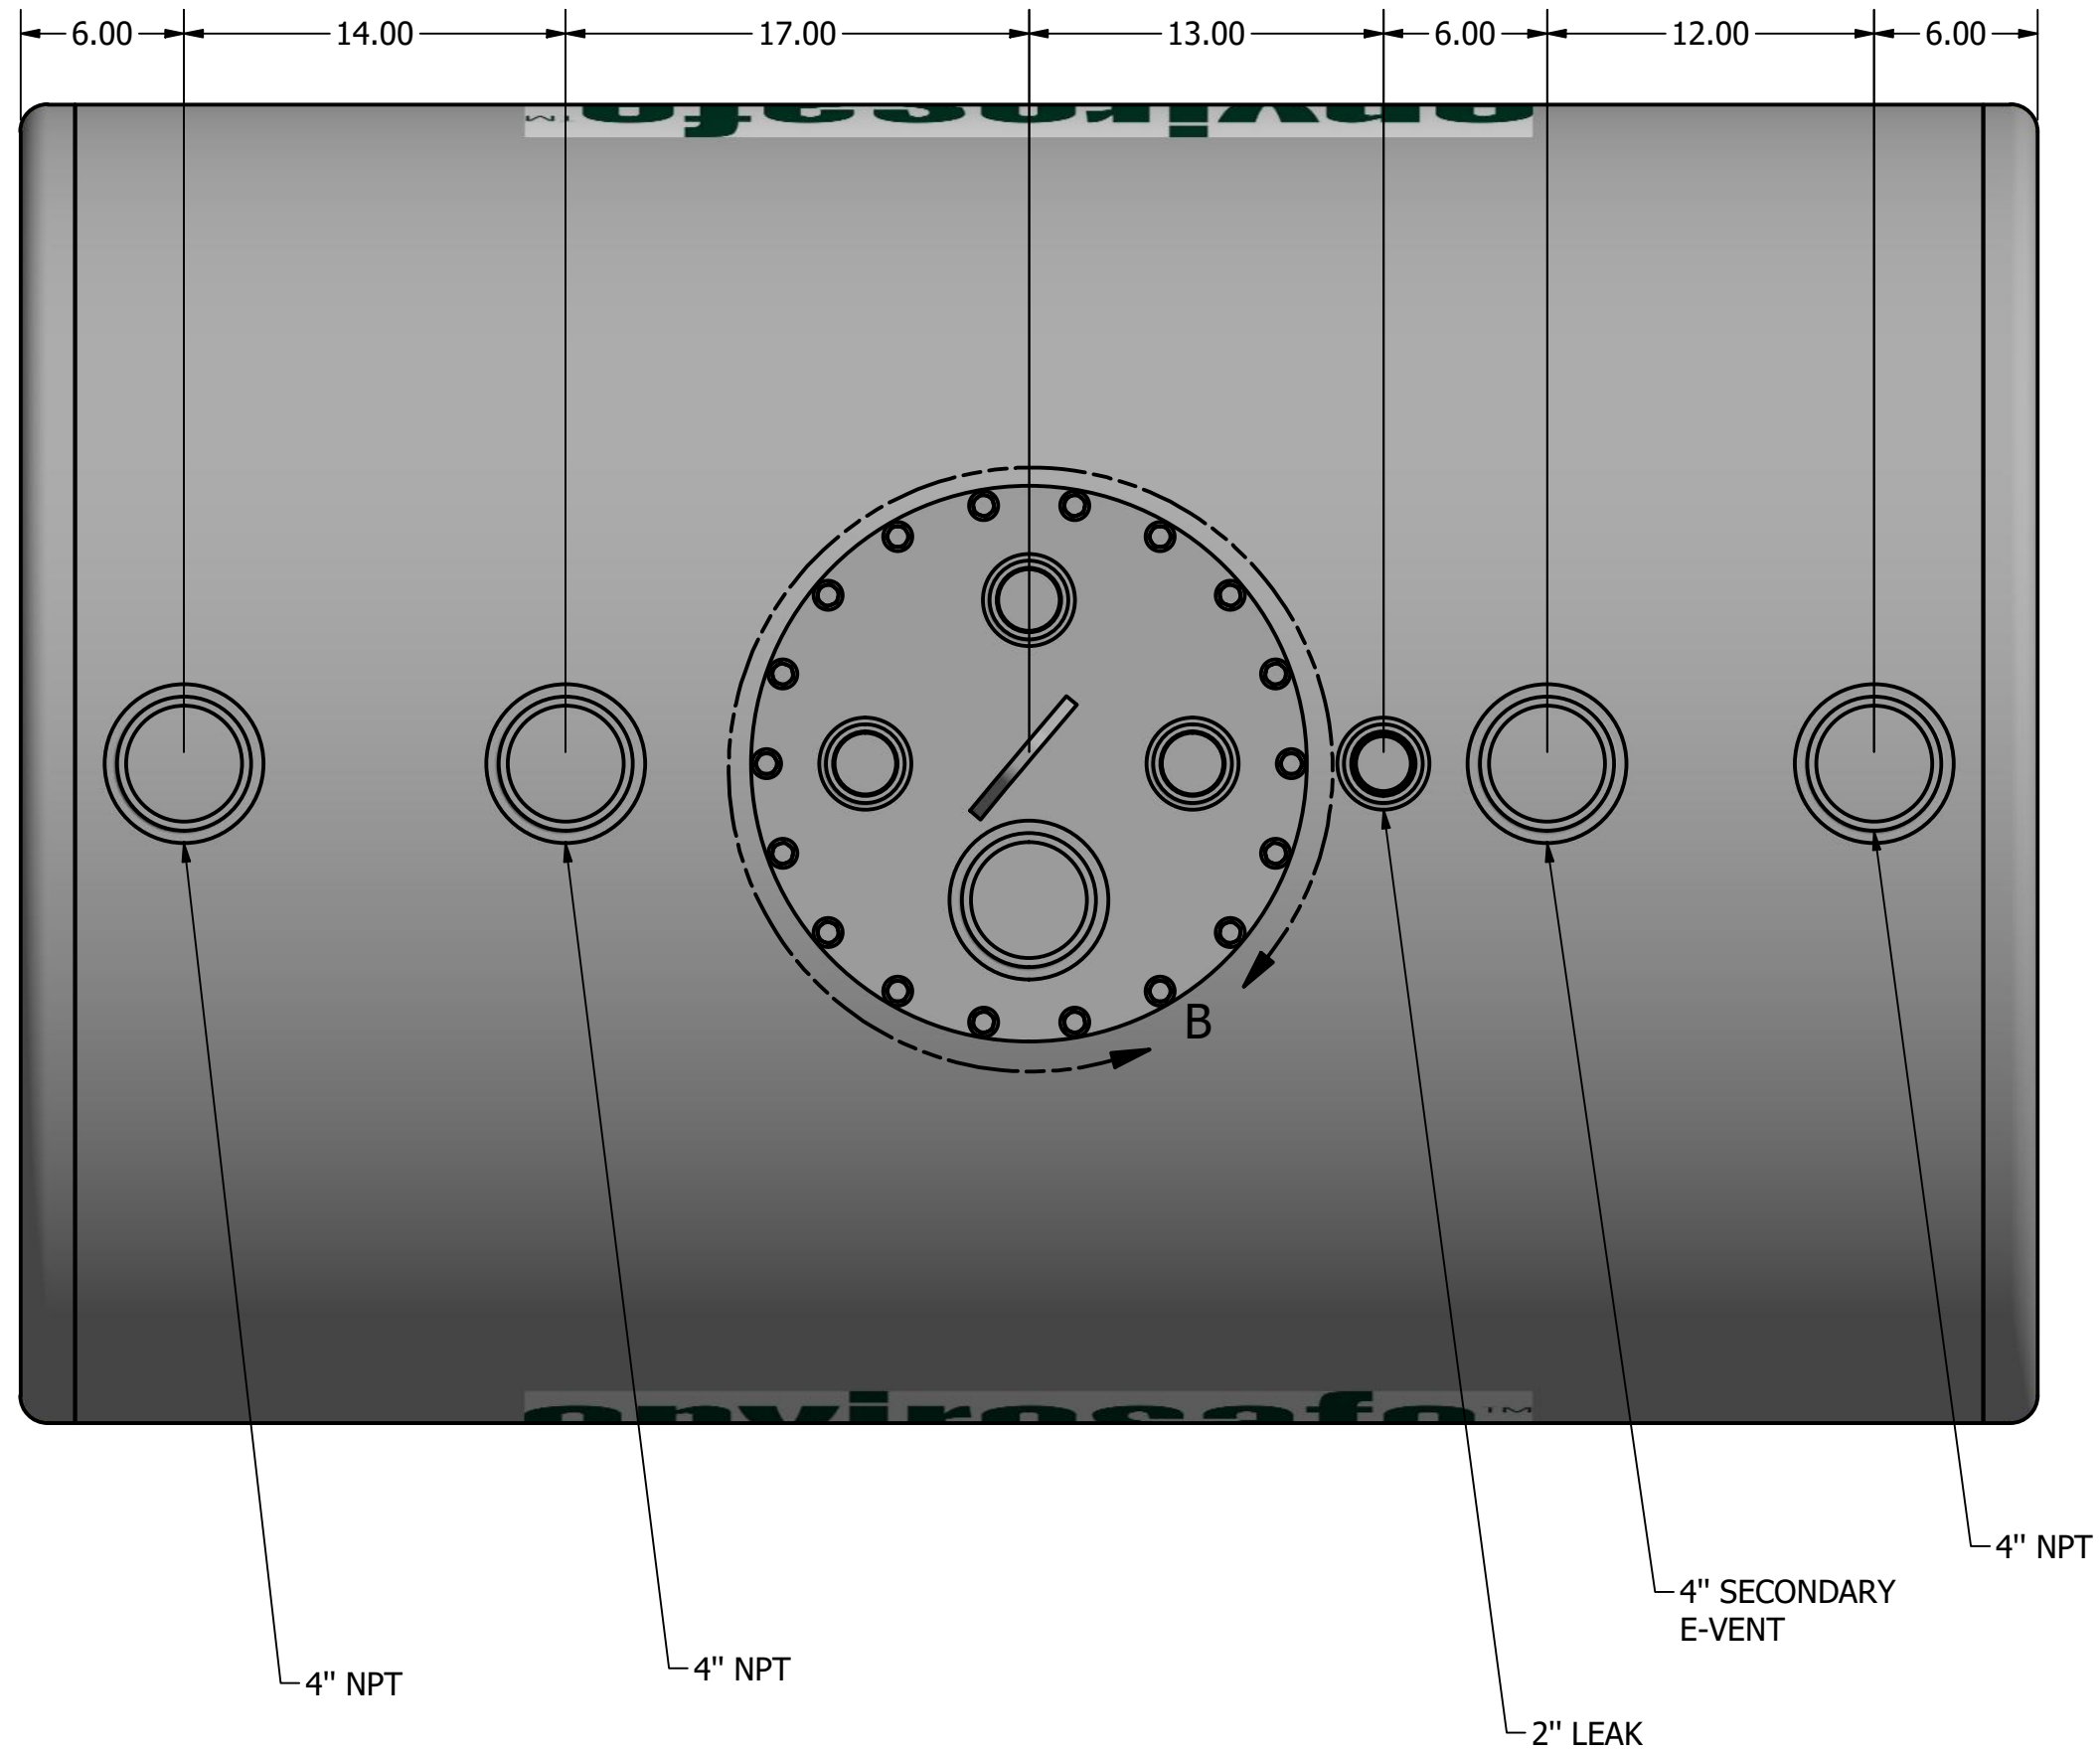

PARTS LIST			
ITEM	QTY	DESCRIPTION	PART NUMBER
1	1	500 GALLON FLAMESHIELD TANK MOUNTED ON SADDLES	500-Gallon-Secondary-Tank-Test
2	1	18" MANWAY FOR EASY INNER TANK ACCESSIBILITY	P-18" MANWAY - 10
3	5	4 IN NPT THREADED FLANGE	P-SERIES 262
4	4	2 IN NPT THREADED FLANGE	P-SERIES 158
5	1	LIFTING LUG	LIFTING LUG SMALL

\*LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED  
DRAWING, WHICH MUST BE RETURNED BEFORE  
PRODUCTION CAN BEGIN\*

#19221

STI  
SwRI  
UL

This document and all information and design thereon are the property of EnviroSAFE Fuel Systems. This document is confidential and must not be made public or copied without written authorization from EnviroSAFE and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by EnviroSAFE. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

DRAWN BY AP MEMCO REP		9/11/2019		MEMCO, INC	
QUOTE # TANK#19221					
Customer Approval Signature				500 GALLON FLAMESHIELD (STOCK TANK)	
				ABOVE-GROUND FUEL SYSTEMS	
SIZE C	DWG NO TANK#19221			REV	
SCALE				SHEET 3 OF 3	